


CLA-VAL


AUTOMATIC CONTROL VALVES

52-03/652-03 4in


Place this manual with personal responsible
for maintenance of this valve

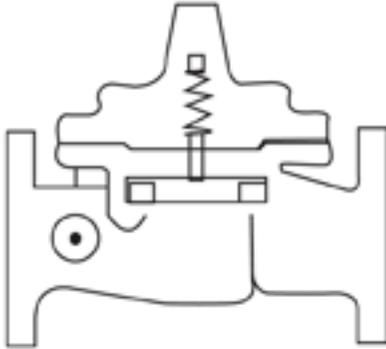

INSTALLATION

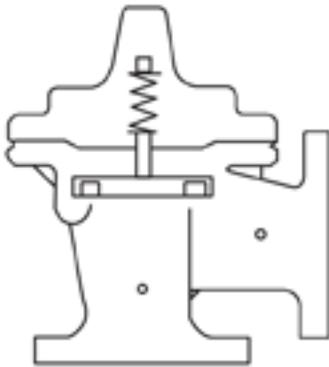

OPERATION

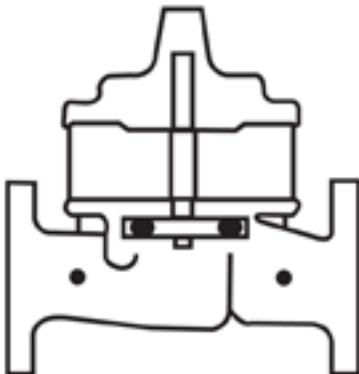

MAINTENANCE

Distributed By:
M&M Control Service, Inc.
Phone: 800-876-0036
Fax: 847-356-0747
Email: sales@mmcontrol.com





CLA-VAL CO.

NEWPORT BEACH, CALIFORNIA

CATALOG NO.
52-03/652-03

DRAWING NO.
90483

REV.
S

TYPE OF VALVE AND MAIN FEATURES


SURGE ANTICIPATOR WITH X102F FLOW LIMITER
 (2 1/2" TO 16" SIZES FOR 52-03 &
 4" TO 24" SIZES FOR 652-03)

DESIGN

DRAW	RW	9-12-80
CHK'D	KD	9-17-80
APV'D	C.H.	9-18-80

100-20 HYTROL (652-03) TO ITEM 1; REDRAWN ON CAD (ECO 15627)
 S ADDED 24" SIZE FOR 652-03 & SIZES REF. TO KN-MAIN VALVE FEAT; CHANGED CK2 COCK "B" TO ITEM 14 (ECO 15824)
 5-21-96

CAD REVISION RECORD - DO NOT REVISE MANUALLY
 DESCRIPTION
 A-N SEE REVISION FILE
 R ITEM 4 WAS CNA NEEDLE VALVE; CAT. NO WAS 52-03; ADDED
 DATE
 BY

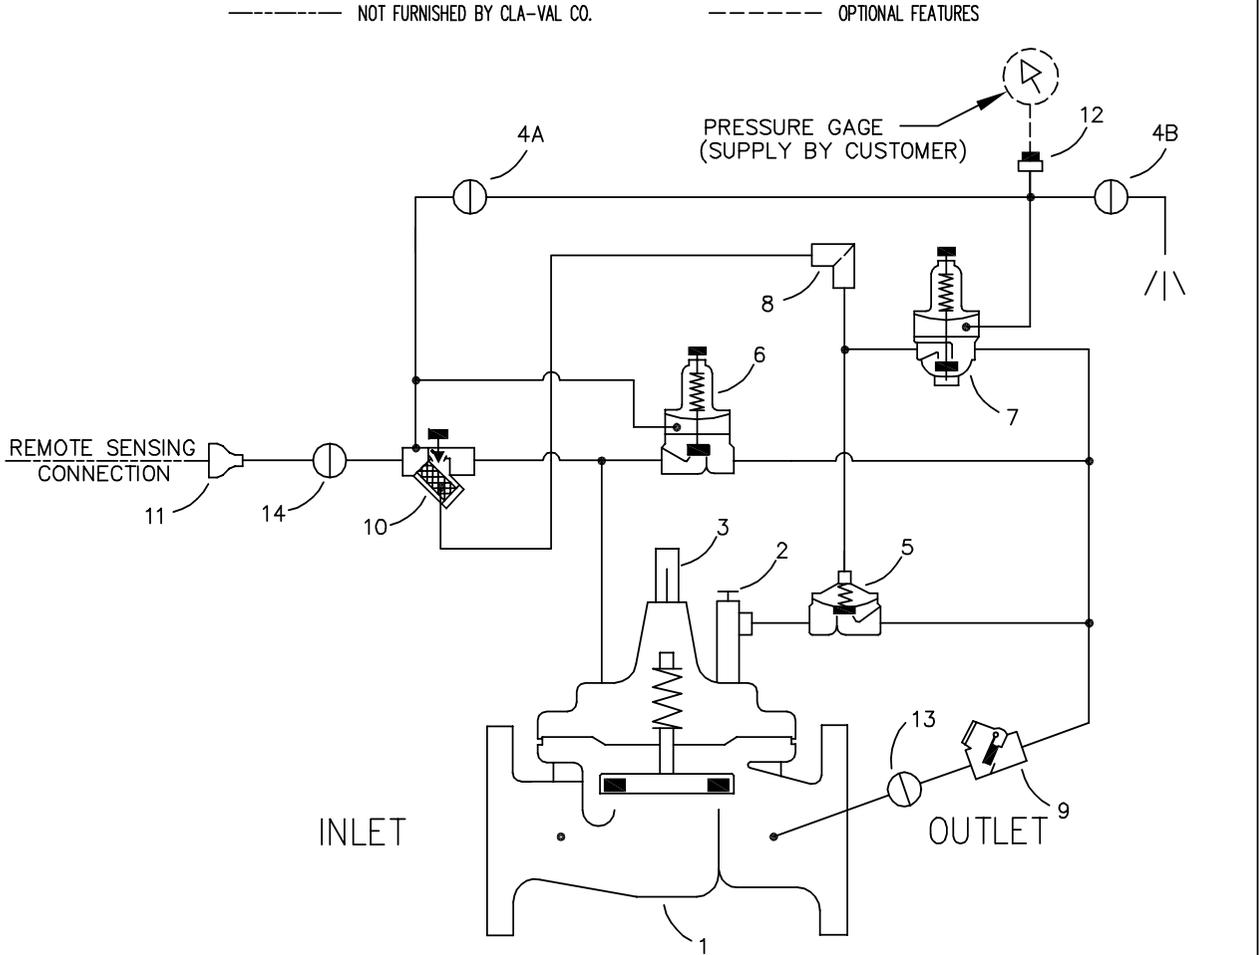

ASSEMBLY NOTE: USE BRACKET TO MOUNT ITEMS 4, 6, 7, 8.
 * USE 100KN FOR ITEM 1 ON 4" & SMALLER SIZES
 ** USE 100-20KN FOR ITEM 1 ON 6" & SMALLER SIZES
 *** INSTALL ITEM 2 IN CENTER COVER BOSS: ON 4" & SMALLER SIZES FOR 52-03,
 ON 6" & SMALLER SIZES FOR 652-03,

ITEM NO.	BASIC COMPONENTS	QTY		
1	* 100-01 HYTROL (52-03) MAIN VALVE	1	8	X58B RESTRICTION TUBE ASSEMBLY
	** 100-20 HYTROL (652-03) MAIN VALVE		9	CSC SWING CHECK VALVE
2	*** X102F FLOW LIMITER	1	10	X42N-3 STRAINER NEEDLE VALVE
3	X101 VALVE POSITION INDICATOR	1	11	BELL REDUCER
4	CK2 COCK (ISOLATION VALVE)	2	12	PIPE PLUG
5	100-01 HYTROL (REVERSE FLOW)	1	13	CK2 COCK (ISOLATION VALVE)
6	CRL PRESSURE RELIEF CONTROL	1	14	CK2 COCK (ISOLATION VALVE)
7	CRA PRESSURE REDUCING CONTROL	1		

OPTIONAL FEATURE SUFFIX	ADDED TO CATALOG NUMBER

THIS DRAWING IS THE PROPERTY OF CLA-VAL CO. AND SAME AND COPIES MADE THEREOF, IF ANY, SHALL BE RETURNED TO IT UPON DEMAND. DELIVERY AND DISCLOSURE HEREOF ARE SOLELY UPON CONDITION THAT THE SAME SHALL NOT BE USED, COPIED OR REPRODUCED, NOR SHALL THE SUBJECT HEREOF BE DISCLOSED IN ANY MANNER TO ANYONE FOR ANY PURPOSE, EXCEPT AS HEREIN AUTHORIZED, WITHOUT PRIOR WRITTEN APPROVAL OF CLA-VAL CO. THIS DRAWING IS SUBMITTED CONFIDENTIALLY AND MAY NOT BE USED IN THE MANUFACTURE OF ANY MATERIAL OR PRODUCT OTHER THAN SUCH MATERIALS AND PRODUCTS FURNISHED TO CLA-VAL CO. WHETHER OR NOT THE EQUIPMENT OR INFORMATION SHOWN HEREON IS PATENTED OR OTHERWISE PROTECTED, FULL TITLE AND COPYRIGHTS, IF ANY, IN AND TO THIS DRAWING AND/OR INFORMATION DELIVERED OR SUBMITTED ARE FULLY RESERVED CLA-VAL CO.



CLA-VAL CO.

NEWPORT BEACH, CALIFORNIA

CATALOG NO.

52-03/652-03

DRAWING NO.

90483

REV.

S

TYPE OF VALVE AND MAIN FEATURES

SURGE ANTICIPATOR WITH X102F FLOW LIMITER
 (2 1/2" TO 16" SIZES FOR 52-03 &
 4" TO 24" SIZES FOR 652-03)

DESIGN

DRAW

RW

9-12-80

CHK'D

KD

9-17-80

APVD

C.H.

9-18-80

OPERATING DATA

I. SURGE RELIEF FEATURE:

PRESSURE RELIEF CONTROL (6) REMAINS CLOSED WHEN UPSTREAM PRESSURE IS LESS THAN THE SET POINT OF CONTROL (6). WHEN UPSTREAM PRESSURE EXCEEDS SET POINT OF CONTROL (6), CONTROL (6) OPENS. THIS RELIEVES THE MAIN VALVE COVER PRESSURE DOWNSTREAM AND THE MAIN VALVE OPENS. PRESSURE RELIEF CONTROL (6) ADJUSTMENT: TURN THE ADJUSTING SCREW CLOCKWISE TO INCREASE PRESSURE SETTING.

II. LOW PRESSURE CONTROL:

PRESSURE REDUCING CONTROL (7) REMAINS CLOSED WHEN UPSTREAM PRESSURE EXCEEDS THE LOW PRESSURE SETTING. THIS CLOSES AUXILIARY HYTROL (5). WHEN UPSTREAM PRESSURE LOWERS TO THE SET POINT OF PRESSURE REDUCING CONTROL (7), CONTROL (7) OPENS. THIS OPENS AUXILIARY HYTROL (5) WHICH IN TURN PERMITS LINE PRESSURE TO OPEN THE MAIN VALVE. PRESSURE REDUCING CONTROL (7) ADJUSTMENT: TURN THE ADJUSTING SCREW CLOCKWISE TO INCREASE PRESSURE SETTING.

CONTROL (7) MAY BE ADJUSTED AFTER THE VALVE IS INSTALLED AS FOLLOWS:

- A. INSTALL A PRESSURE GAGE BETWEEN CK2 COCKS (4A) AND (4B).
- B. TURN THE ADJUSTING SCREW ON PRESSURE REDUCING CONTROL (7) COUNTERCLOCKWISE TO RELIEVE THE SPRING LOAD. THIS IS THE LOWEST SETTING FOR PRESSURE REDUCING CONTROL (7).
- C. CLOSE CK2 COCK (4B) AND OPEN CK2 COCK (4A).
- D. PRESSURIZE THE MAIN VALVE (1) IN THE CLOSED POSITION AND BLEED AIR FROM ALL HIGH POINTS. NORMAL PRESSURE SHOULD BE SHOWN ON THE PRESSURE GAGE.
- E. CLOSE CK2 COCK (4A).
- F. SLIGHTLY OPEN CK2 COCK (4B) AND WHEN THE DESIRED LOW PRESSURE OPENING IS REACHED, CLOSE VALVE (4B).
- G. TURN CONTROL (7) ADJUSTING SCREW SLOWLY CLOCKWISE UNTIL CONTROL (7) OPENS WHICH IN TURN OPENS AUXILIARY HYTROL (5) AND THE MAIN VALVE (1).

THE FOLLOWING METHODS MAY BE USED TO DETERMINE WHEN THE MAIN VALVE OPENS:

- 6" AND LARGER SIZE VALVES
 [] OBSERVE STEM IN X101 POSITION INDICATOR (3).

CAD REVISION RECORD - DO NOT REVISE MANUALLY

DATE

BY

DESCRIPTION

SEE SHEET 1

LTR



CLA-VAL CO.

NEWPORT BEACH, CALIFORNIA

CATALOG NO.

52-03/652-03

DRAWING NO.

90483

REV.

S

TYPE OF VALVE AND MAIN FEATURES

SURGE ANTICIPATOR WITH X102F FLOW LIMITER
 (2 1/2" TO 16" SIZES FOR 52-03 &
 4" TO 24" SIZES FOR 652-03)

DESIGN

DRAW

RW

9-12-80

CHK'D

KD

9-17-80

APVD

C.H.

9-18-80

OPERATING DATA CONTINUED

4" & SMALLER SIZE VALVES

[] OBSERVE MAIN VALVE DISCHARGE IF VISIBLE.

[] INSTALL A PRESSURE GAGE IN THE MAIN VALVE (1) COVER AND THE INDICATOR WILL "DIP" WHEN THE MAIN VALVE (1) OPENS.

DURING A POWER FAILURE THE MAIN VALVE WILL OPEN WHEN REMOTELY SENSED PRESSURE LOWERS TO THE DESIRED LOW PRESSURE POINT AS SET IN PARAGRAPH "F" ABOVE.

H. OPEN CK2 COCK (4A).

III. CLOSING SPEED CONTROL:

NEEDLE VALVE (10) CONTROLS THE CLOSING SPEED OF THE MAIN VALVE. TURN THE ADJUSTING STEM CLOCKWISE TO MAKE THE MAIN VALVE CLOSE SLOWER. DO NOT CLOSE VALVE (10) COMPLETELY OR THE MAIN VALVE WILL NOT CLOSE. (SUGGESTED INITIAL SETTING OF NEEDLE VALVE IS 1/4 TO 1/2 TURN OPEN.)

IV. LIMIT ADJUSTMENT FEATURE:

THIS VALVE IS EQUIPPED WITH FLOW LIMITER (2) THAT MECHANICALLY LIMITS THE OPENING OF THE MAIN VALVE. WITH THE ADJUSTING SCREW TURNED CLOCKWISE, ALL THE WAY IN, THE MAIN VALVE DISC IS MECHANICALLY HELD ON THE SEAT. WITH THE ADJUSTING SCREW TURNED COUNTERCLOCKWISE, ALL THE WAY OUT, THE MAIN VALVE OPENING IS NOT LIMITED. THE LIMIT ASSEMBLY (2) MAY BE ADJUSTED TO LIMIT THE MAIN VALVE OPENING AT ANY POINT BETWEEN THE FULL OPEN AND FULL CLOSED POSITION.

V. CHECK LIST FOR PROPER OPERATION:

- () SYSTEM VALVES OPEN UPSTREAM AND DOWNSTREAM.
- () AIR REMOVED FROM THE MAIN VALVE COVER AND PILOT SYSTEM AT ALL HIGH POINTS.
- () REMOTE SENSING LINE PROPERLY CONNECTED.
- () CK2 COCKS (4A), (13) AND (14) OPEN DURING NORMAL OPERATION.
- () CK2 COCK (4B) CLOSED DURING NORMAL OPERATION.

CAD REVISION RECORD - DO NOT REVISE MANUALLY

DATE

BY

DESCRIPTION

LTR

SEE SHEET 1



CLA-VAL CO.

NEWPORT BEACH, CALIFORNIA

CATALOG NO.
52-03/652-03

DRAWING NO.
90483

REV.
S

TYPE OF VALVE AND MAIN FEATURES

SURGE ANTICIPATOR WITH X102F FLOW LIMITER
(2 1/2" TO 16" SIZES FOR 52-03 &
4" TO 24" SIZES FOR 652-03)

DESIGN

DRAW	RW	9-12-80
CHK'D	KD	9-17-80
APVD	C.H.	9-18-80

ADJUSTMENT PROCEDURE FOR 52-03/652-03
SURGE CONTROL VALVE

I. PRELIMINARY ADJUSTMENTS:

- A. TURN ADJUSTING SCREW ON CRL PRESSURE RELIEF CONTROL (6) ALL THE WAY IN, CLOCKWISE. DO NOT FORCE.
- B. TURN ADJUSTING SCREW ON X102F FLOW LIMITER (2) STEM VALVE ALL THE WAY IN, CLOCKWISE.
- C. TURN ADJUSTING SCREW ON CRA PRESSURE REDUCING CONTROL (7) ALL THE WAY OUT, COUNTERCLOCKWISE.
- D. OPEN NEEDLE VALVE (10) ONE HALF TURN.
- E. OPEN CK2 COCK (4A) ALL THE WAY.
- F. CLOSE CK2 COCK (4B).
- G. OPEN CK2 COCKS (13) AND (14) IN THE PILOT SYSTEM.
- H. OPEN GATE VALVE AHEAD OF MAIN VALVE.

II. ADJUSTMENTS TO BE MADE WITH PUMP STOPPED:

- A. ADJUST THE CRL PRESSURE RELIEF CONTROL (6) UNTIL THE MAIN VALVE (1) WILL JUST STAY CLOSED. THIS IS DONE BY BACKING OUT ON THE ADJUSTING SCREW OF THE CRL UNTIL THE MAIN VALVE JUST STARTS TO OPEN, THEN TURN IT IN APPROXIMATELY 1/4 TO 1/2 TURN.
- B. TURN ADJUSTING SCREW ON CRA PRESSURE REDUCING CONTROL (7) IN CLOCKWISE UNTIL MAIN VALVE (1) STARTS TO OPEN, THEN TURN IN ONE TO TWO ADDITIONAL TURNS.
- C. AS MAIN VALVE (1) STARTS TO OPEN, BACK OUT ON X102F ADJUSTING SCREW UNTIL THE MAIN VALVE OPENS FAR ENOUGH TO DROP THE MAIN LINE PRESSURE APPROXIMATELY 25%.
- D. BACK OUT ON CRA PRESSURE REDUCING CONTROL (7) ADJUSTING SCREW COUNTERCLOCKWISE UNTIL THE MAIN VALVE (1) STARTS TO CLOSE, THEN BACK OUT 1/2 TURN MORE.
- E. CHECK OPERATION OF THE MAIN VALVE (1) BY CLOSING CK2 COCK (4A) AND OPENING CK2 COCK (4B). AS SOON AS MAIN VALVE (1) OPENS, CLOSE CK2 COCK (4B) AND OPEN CK2 COCK (4A); THE MAIN VALVE (1) SHOULD CLOSE.
- F. START PUMP AND READJUST CRL PRESSURE RELIEF CONTROL (6) UNTIL THE MAIN VALVE (1) JUST STAYS CLOSED AS IN PARAGRAPH "A" ABOVE.

CAD REVISION RECORD - DO NOT REVISE MANUALLY

DATE

BY

DESCRIPTION

LTR

SEE SHEET 1

 CLA-VAL CO. NEWPORT BEACH, CALIFORNIA	CATALOG NO.	DRAWING NO.	REV.
	52-03/652-03	90483	S
	TYPE OF VALVE AND MAIN FEATURES		
	SURGE ANTICIPATOR WITH X102F FLOW LIMITER (2 1/2" TO 16" SIZES FOR 52-03 & 4" TO 24" SIZES FOR 652-03)		
DESIGN			
DRAW	RW	9-12-80	
CHK'D	KD	9-17-80	
AP'VD	C.H.	9-18-80	

OPERATING DESCRIPTION

THE 52-03/652-03 SURGE CONTROL VALVE IS DESIGNED TO BE USED IN CONJUNCTION WITH A BOOSTER PUMPING SYSTEM TO PREVENT EXCESSIVE SURGE PRESSURES IN THE EVENT OF POWER FAILURE. THE VALVE IS HYDRAULICALLY OPERATED WITH PILOTS THAT WILL CAUSE THE VALVE TO OPEN ON EITHER A LOW PRESSURE OR HIGH PRESSURE WAVE. UNDER NORMAL OPERATION THE VALVE CAN FUNCTION AS A RELIEF VALVE WHICH CAN BE SET TO OPEN AT ANY PRESSURE ABOVE THE NORMAL OPERATING PRESSURE. THE LOW PRESSURE PILOT CAN BE SET TO OPEN THE MAIN VALVE AT ANY PRESSURE BELOW ITS NORMAL OPERATING PRESSURE.

POWER FAILURE TO A BOOSTER PUMP WILL USUALLY RESULT IN A DOWN SURGE IN PRESSURE FOLLOWED BY AN UP SURGE IN PRESSURE. THE 52-03/652-03 SURGE CONTROL VALVE WILL OPEN ON THIS INITIAL DOWN SURGE IN PRESSURE AND WILL REMAIN OPEN SO THAT WHEN THE HIGH PRESSURE WAVE RETURNS, IT WILL PASS THROUGH THE VALVE WITHOUT GENERATING A LARGE UP SURGE IN PRESSURE. AFTER THIS WAVE HAS PASSED, THE VALVE WILL THEN CLOSE SLOWLY WITHOUT GENERATING ANY FURTHER PRESSURE SURGES.

REFERRING TO THE 52-03/652-03 SCHEMATIC, PRESSURE FROM THE REMOTE SENSING CONNECTION FLOWS THROUGH X42N-3 STRAINER (10) INTO THE COVER CHAMBER OF MAIN VALVE (1). FROM THE COVER CHAMBER, THE FLUID FLOWS OUT THROUGH X102F FLOW LIMITER (2), THEN THROUGH THE 100-01 AUXILIARY HYTROL (5) AND THEN TO THE DOWNSTREAM SIDE OF THE MAIN VALVE (1). THE AUXILIARY HYTROL (5) IS KEPT CLOSED BY PRESSURE FROM THE REMOTE SENSING CONNECTION FLOWING THROUGH X58B RESTRICTION ASSEMBLY (8) INTO THE COVER CHAMBER OF THE AUXILIARY HYTROL (5). THE CRA PRESSURE REDUCING CONTROL (7) IS THE LOW PRESSURE PILOT AND IS A NORMALLY OPEN PILOT HELD CLOSED BY PRESSURE UNDER ITS DIAPHRAGM FROM THE REMOTE SENSING CONNECTION. THE CRL PRESSURE RELIEF CONTROL (6) IS A NORMALLY CLOSED PILOT AND REQUIRES PRESSURE UNDER ITS DIAPHRAGM TO CAUSE IT TO OPEN AGAINST ITS SPRING SETTING.

THE CRL PRESSURE RELIEF CONTROL (6) SHOULD BE ADJUSTED SO THAT THE MAIN VALVE (1) WILL JUST STAY CLOSED DURING A PUMPING CONDITION. THE CRA PRESSURE REDUCING CONTROL (7) - LOW PRESSURE PILOT MUST BE SET SO THAT IT WILL OPEN ON THE INITIAL DOWN SURGE CREATED BY THE PUMP FAILURE BUT WILL AGAIN CLOSE AS SOON AS THE INITIAL DOWN SURGE HAS PASSED. THE INITIAL DOWN SURGE IN PRESSURE WILL OPEN THE CRA PRESSURE REDUCING CONTROL (7) WHICH WILL BLEED THE PRESSURE OFF OF THE COVER CHAMBER OF THE AUXILIARY HYTROL (5) FASTER THAN IT CAN BE SUPPLIED THROUGH THE X58B RESTRICTION ASSEMBLY (8) CAUSING AUXILIARY HYTROL (5) TO OPEN. IF THE SYSTEM PRESSURE IS STILL POSITIVE DURING THE DOWN SURGE IN PRESSURE, THE PRESSURE UNDER THE MAIN VALVE DISC WILL PUSH VALVE OPEN AND THE FLUID IN THE MAIN VALVE DIAPHRAGM CHAMBER WILL EVACUATE THROUGH THE X102F FLOW LIMITER (2), THROUGH THE AUXILIARY

CAD REVISION RECORD - DO NOT REVISE MANUALLY	DATE	
	BY	
DESCRIPTION	SEE SHEET 1	
LTR		

THIS DRAWING IS THE PROPERTY OF CLA-VAL CO. AND SAME AND COPIES MADE THEREOF, IF ANY, SHALL BE RETURNED TO IT UPON DEMAND. DELIVERY AND DISCLOSURE HEREOF ARE SOLELY UPON CONDITION THAT THE SAME SHALL NOT BE USED, COPIED OR REPRODUCED, NOR SHALL THE SUBJECT HEREOF BE DISCLOSED IN ANY MANNER TO ANYONE FOR ANY PURPOSE, EXCEPT AS HEREIN AUTHORIZED, WITHOUT PRIOR WRITTEN APPROVAL OF CLA-VAL CO. THIS DRAWING IS SUBMITTED CONFIDENTIALLY AND MAY NOT BE USED IN THE MANUFACTURE OF ANY MATERIAL OR PRODUCT OTHER THAN SUCH MATERIALS AND PRODUCTS FURNISHED TO CLA-VAL CO. WHETHER OR NOT THE EQUIPMENT OR INFORMATION SHOWN HEREON IS PATENTED OR OTHERWISE PROTECTED, FULL TITLE AND COPYRIGHTS, IF ANY, IN AND TO THIS DRAWING AND/OR INFORMATION DELIVERED OR SUBMITTED ARE FULLY RESERVED CLA-VAL CO.



CLA-VAL CO.

NEWPORT BEACH, CALIFORNIA

CATALOG NO.

52-03/652-03

DRAWING NO.

90483

REV.

S

TYPE OF VALVE AND MAIN FEATURES

SURGE ANTICIPATOR WITH X102F FLOW LIMITER
(2 1/2" TO 16" SIZES FOR 52-03 &
4" TO 24" SIZES FOR 652-03)

DESIGN

DRAW

RW

9-12-80

CHK'D

KD

9-17-80

APVD

C.H.

9-18-80

OPERATING DESCRIPTION CONTINUED

HYTROL (5) TO THE DOWNSTREAM SIDE OF THE MAIN VALVE (1). THE X102F FLOW LIMITER (2) IS USED DURING THIS PART OF THE RELIEF CYCLE TO PREVENT THE VALVE FROM GOING TOO FAR OPEN WHICH COULD DROP THE SYSTEM PRESSURE TOO LOW IN WHICH CASE THE CRA PRESSURE REDUCING CONTROL (7) WOULD NOT CLOSE. THE VALVE IS NOW OPEN SO THAT WHEN THE UP SURGE IN PRESSURE RETURNS, IT WILL PASS THROUGH THE VALVE WITHOUT CREATING ANY UNDUE PRESSURE SURGES ON THE SYSTEM. IF THE MAIN VALVE IS NOT OPEN FAR ENOUGH WHEN THE UP SURGE IN PRESSURE RETURNS, IT WILL OPEN THE CRL PRESSURE RELIEF CONTROL (6), WHICH WILL IN TURN OPEN MAIN VALVE (1) FURTHER TO RELIEVE ANY EXCESS PRESSURE. AS SOON AS THE PRESSURE RISES ABOVE THE SET POINT OF CRA PRESSURE REDUCING CONTROL (7), IT WILL CLOSE, WHICH WILL IN TURN CLOSE THE AUXILIARY HYTROL (5) AND THE MAIN VALVE (1) WILL THEN START TO CLOSE THROUGH THE REMOTE SENSING LINE. DURING THE CLOSING CYCLE THE MAIN VALVE (1) IS UNDER CONTROL OF CRL PRESSURE RELIEF CONTROL (6), WHICH WILL PREVENT ANY SURGES TO THE SYSTEM.

IF DURING THE INITIAL DOWN SURGE IN PRESSURE FOLLOWING THE PUMP FAILURE THE SYSTEM PRESSURE SHOULD GO NEGATIVE, THEN THE CHECK VALVE (9) WILL PREVENT ATMOSPHERIC PRESSURE FROM COMING INTO THE MAIN VALVE (1) COVER CHAMBER AND THE NEGATIVE PRESSURE FROM THE SYSTEM WILL BE APPLIED TO THE MAIN VALVE (1) COVER CHAMBER THROUGH THE REMOTE SENSING LINE CONNECTION, X42N-3 STRAINER (10), X58B RESTRICTION ASSEMBLY (8), CRA PRESSURE REDUCING CONTROL (7), AND THE AUXILIARY HYTROL (5) WHICH WILL CAUSE THE MAIN VALVE TO OPEN. AS SOON AS THE NEGATIVE PRESSURE DISSIPATES AND RETURNS TO NORMAL, THE MAIN VALVE (1) WILL CLOSE IN THE NORMAL MANNER UNDER CONTROL OF THE CRL PRESSURE RELIEF CONTROL (6).

CAD REVISION RECORD - DO NOT REVISE MANUALLY

DESCRIPTION

DATE

BY

LTR

SEE SHEET 1




—MODEL— **100-01**
Hytrol Valve

Description

The Cla-Val Model 100-01 Hytrol Valve is a main valve for Cla-Val Automatic Control Valves. It is a hydraulically operated, diaphragm-actuated, globe or angle pattern valve.

This valve consists of three major components; body, diaphragm assembly, and cover. The diaphragm assembly is the only moving part. The diaphragm assembly uses a diaphragm of nylon fabric bonded with synthetic rubber. A synthetic rubber disc, contained on three and one half sides by a disc retainer and disc guide, forms a seal with the valve seat when pressure is applied above the diaphragm. The diaphragm assembly forms a sealed chamber in the upper portion of the valve, separating operating pressure from line pressure.

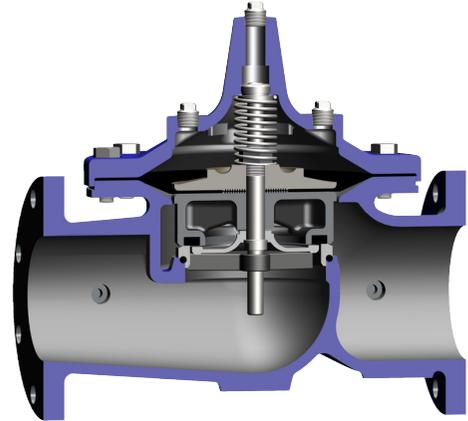


Installation

1. Before valve is installed, pipe lines should be flushed of all chips, scale and foreign matter.
2. It is recommended that either gate or block valves be installed on both ends of the 100-01 Hytrol Valve to facilitate isolating the valve for preventive maintenance and repairs.
3. Place the valve in the line with flow through the valve in the direction indicated on the inlet nameplate. (See "Flow Direction" Section)
4. Allow sufficient room around valve to make adjustments and for disassembly.
5. Cla-Val 100-01 Hytrol Valves operate with maximum efficiency when mounted in horizontal piping with the cover UP, however,


- other positions are acceptable. Due to size and weight of the cover and internal components of 8 inch and larger valves, installation with the cover UP is advisable. This makes internal parts readily accessible for periodic inspection.
6. If a pilot control system is installed on the 100-01 Hytrol Valve, use care to prevent damage. If it is necessary to remove fittings or components, be sure they are kept clean and replaced exactly as they were.
7. After the valve is installed and the system is first pressurized, vent air from the cover chamber and pilot system tubing by loosening fittings at all high points.

Principles of Operation

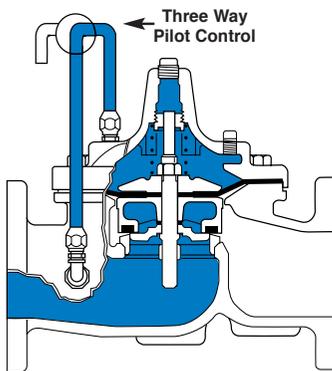


Tight Closing Operation

When pressure from the valve inlet (or an equivalent independent operating pressure) is applied to the diaphragm chamber the valve closes drip-tight.

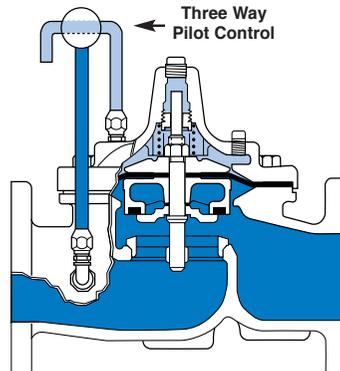

Full Open Operation

When pressure in diaphragm chamber is relieved to a zone of lower pressure (usually atmosphere) the line pressure (5 psi Min.) at the valve inlet opens the valve.

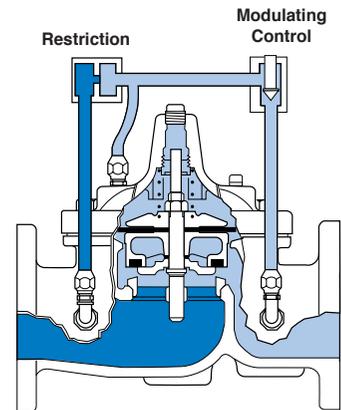


Modulating Action

Valve modulates when diaphragm pressure is held at an intermediate point between inlet and discharge pressure. With the use of a Cla-Val. "modulating control," which reacts to line pressure changes, the pressure above the diaphragm is varied, allowing the valve to throttle and compensate for the change.

Flow Direction

The flow through the 100-01 Hytrol Valve can be in one of two directions. When flow is “up-and-over the seat,” it is in “normal” flow and the valve will fail in the open position. When flow is “over-the seat-and down,” it is in “reverse” flow and the valve will fail in the closed position. There are no permanent flow arrow markings.

The valve must be installed according to nameplate data.



Recommended Tools

1. Three pressure gauges with ranges suitable to the installation to be put at Hytrol inlet, outlet and cover connections.
2. Cla-Val Model X101 Valve Position Indicator. This provides visual indication of valve position without disassembly of valve.
3. Other items are: suitable hand tools such as screwdrivers, wrenches, etc. soft jawed (brass or aluminum) vise, 400 grit wet or dry sandpaper and water for cleaning.

Troubleshooting

The following troubleshooting information deals strictly with the Model 100-01 Hytrol Valve. This assumes that all other components of the pilot control system have been checked out and are in proper working condition. (See appropriate sections in Technical Manual for complete valve).

All trouble shooting is possible without removing the valve from the line or removing the cover. It is highly recommended to permanently install a Model X101 Valve Position Indicator and three gauges in unused Hytrol inlet, outlet and cover connections.

SYMPTOM	PROBABLE CAUSE	REMEDY
Fails to Close	Closed isolation valves in control system, or in main line.	Open Isolation valves.
	Lack of cover chamber pressure.	Check upstream pressure, pilot system, strainer, tubing, valves, or needle valves for obstruction.
	Diaphragm damaged. (See Diaphragm Check.)	Replace diaphragm.
	Diaphragm assembly inoperative. Corrosion or excessive scale build up on valve stem. (See Freedom of Movement Check)	Clean and polish stem. Inspect and replace any damaged or badly eroded part.
	Mechanical obstruction. Object lodged in valve. (See Freedom of Movement Check)	Remove obstruction.
	Worn disc. (See Tight Sealing Check)	Replace disc.
	Badly scored seat. (See Tight Sealing Check)	Replace seat.
Fails to Open	Closed upstream and/or downstream isolation valves in main line.	Open isolation valves.
	Insufficient line pressure.	Check upstream pressure. (Minimum 5 psi flowing line pressure differential.)
	Diaphragm assembly inoperative. Corrosion or excessive buildup on valve stem. (See Freedom of Movement Check)	Clean and polish stem. Inspect and replace any damaged or badly eroded part.
	Diaphragm damaged. (For valves in "reverse flow" only)	Replace diaphragm.

After checking out probable causes and remedies, the following three checks can be used to diagnose the nature of the problem before maintenance is started. They must be done in the order shown.

Three Checks

The 100-01 Hytrol Valve has only one moving part (the diaphragm and disc assembly). So, there are only three major types of problems to be considered.

First: Valve is stuck - that is, the diaphragm assembly is not free to move through a full stroke either from open to close or vice versa.

Second: Valve is free to move and can't close because of a worn out diaphragm.

Third: Valve leaks even though it is free to move and the diaphragm isn't leaking.

CAUTION:

*Care should be taken when doing the troubleshooting checks on the 100-01 Hytrol Valve. These checks do require the valve to open fully. This will either allow a high flow rate through the valve, or the downstream pressure will quickly increase to the inlet pressure. In some cases, this can be very harmful. Where this is the case, and there are no block valves in the system to protect the downstream piping, it should be realized that **the valve cannot be serviced under pressure.** Steps should be taken to remedy this situation before proceeding any further.*

Diaphragm Check (#1)

1. Shut off pressure to the Hytrol Valve by slowly closing upstream and downstream isolation valves. **SEE CAUTION.**
2. Disconnect or close all pilot control lines to the valve cover and leave only one fitting in highest point of cover open to atmosphere.
3. With the cover vented to atmosphere, slowly open upstream isolation valve to allow some pressure into the Hytrol Valve body. Observe the open cover tapping for signs of continuous flow. It is not necessary to fully open isolating valve. Volume in cover chamber capacity chart will be displaced as valve moves to open position. Allow sufficient time for diaphragm assembly to shift positions. If there is no continuous flow, you can be quite certain the diaphragm is sound and the diaphragm assembly is tight. If the fluid appears to flow continuously this is a good reason to believe the diaphragm is either damaged or it is loose on the stem. In either case, this is sufficient cause to remove the valve cover and investigate the leakage. (See "Maintenance" Section for procedure.)

COVER CHAMBER CAPACITY (Liquid Volume displaced when valve opens)

Valve size (inches)	Displacement	
	Gallons	Liters
1 1/4	.020	.07
1 1/2	.020	.07
2	.032	.12
2 1/2	.043	.16
3	.080	.30
4	.169	.64
6	.531	2.0
8	1.26	4.8
10	2.51	9.5
12	4.00	15.1
14	6.50	24.6
16	9.57	36.2
24	29.00	109.8
36	90.00	340.0

Freedom of Movement Check (#2)

4. Determining the Hytrol Valve's freedom of movement can be done by one of two methods.
5. For most valves it can be done after completing Diaphragm Check (Steps 1, 2, and 3). **SEE CAUTION.** At the end of step 3 the valve should be fully open.
6. If the valve has a Cla-Val X101 Position Indicator, observe the indicator to see that the valve opens wide. Mark the point of maximum opening.
7. Re-connect enough of the control system to permit the application of inlet pressure to the cover. Open pilot system cock so pressure flows from the inlet into the cover.
8. While pressure is building up in the cover, the valve should close smoothly. There is a hesitation in every Hytrol Valve closure, which can be mistaken for a mechanical bind. The stem will appear to stop moving very briefly before going to the closed position. This slight pause is caused by the diaphragm flexing at a particular point in the valve's travel and is not caused by a mechanical bind.
9. When closed, a mark should be made on the X101 Valve position indicator corresponding to the "closed" position. The distance between the two marks should be approximately the stem travel shown in chart.

STEM TRAVEL

(Fully Open to Fully Closed)

Valve Size (inches)		Travel (inches)	
Inches	MM	Inches	MM
1 1/4	32	0.4	10
1 1/2	40	0.4	10
2	50	0.6	15
2 1/2	65	0.7	18
3	80	0.8	20
4	100	1.1	28
6	150	1.7	43
8	200	2.3	58
10	250	2.8	71
12	300	3.4	86
14	350	4.0	100
16	400	4.5	114
24	600	6.5	165
36	900	8.5	216

10. If the stroke is different than that shown in stem travel chart this is a good reason to believe something is mechanically restricting the stroke of the valve at one end of its travel. If the flow does not stop through the valve when in the indicated "closed" position, the obstruction probably is between the disc and the seat. If the flow does stop, then the obstruction is more likely in the cover. In either case, the cover must be removed, and the obstruction located and removed. The stem should also be checked for scale build-up. (See "Maintenance, section for procedure.)

11. For valves 6" and smaller, the Hytrol Valve's freedom of movement check can also be done after all pressure is removed from the valve. **SEE CAUTION.** After closing inlet and outlet isolation valves and bleeding pressure from the valve, check that the cover chamber and the body are temporarily vented to atmosphere. Insert fabricated tool into threaded hole in top of valve stem, and lift the diaphragm assembly manually. Note any roughness. The diaphragm assembly should move smoothly throughout entire valve stroke. The tool is fabricated from rod that is threaded on one end to fit valve stem and has a "T" bar handle of some kind on the other end for easy gripping. (See chart in Step 4 of "Disassembly" Section.)

12. Place marks on this diaphragm assembly lifting tool when the valve is closed and when manually positioned open. The distance between the two marks should be approximately the stem travel shown in stem travel chart. If the stroke is different than that shown, there is a good reason to believe something is mechanically restricting the stroke of the valve. The cover must be removed, and the obstruction located and removed. The stem should also be checked for scale build-up. (See "Maintenance" Section for procedure.)

Tight Sealing Check (#3)

13. Test for seat leakage after completing checks #1 & #2 (Steps 1 to 12). **SEE CAUTION.** Close the isolation valve downstream of the Hytrol Valve. Apply inlet pressure to the cover of the valve, wait until it closes. Install a pressure gauge between the two closed valves using one of the two ports in the outlet side of the Hytrol. Watch the pressure gauge. If the pressure begins to climb, then either the downstream isolation valve is permitting pressure to creep back, or the Hytrol is allowing pressure to go through it. Usually the pressure at the Hytrol inlet will be higher than on the isolation valve discharge, so if the pressure goes up to the inlet pressure, you can be sure the Hytrol is leaking. Install another gauge downstream of isolating valve. If the pressure between the valves only goes up to the pressure on the isolation valve discharge, the Hytrol Valve is holding tight, and it was just the isolation valve leaking.

Maintenance

Preventative Maintenance


The Cla-Val Co. Model 100-01 Hytrol Valve requires no lubrication or packing and a minimum of maintenance. However, a periodic inspection schedule should be established to determine how the operating conditions of the system are affecting the valve. The effect of these actions must be determined by inspection.

Disassembly

Inspection or maintenance can be accomplished without removing the valve from the line. Repair kits with new diaphragm and disc are recommended to be on hand before work begins.

WARNING: Maintenance personnel can be injured and equipment damaged if disassembly is attempted with pressure in the valve. **SEE CAUTION.**

1. Close upstream and downstream isolation valves **and independent operating pressure when used** to shut off all pressure to the valve.
2. Loosen tube fittings in the pilot system to remove pressure from valve body and cover chamber. After pressure has been released from the valve, use care to remove the controls and tubing. Note and sketch position of tubing and controls for re-assembly. The schematic in front of the Technical Manual can be used as a guide when reassembling pilot system.
3. Remove cover nuts and remove cover. If the valve has been in service for any length of time, chances are the cover will have to be loosened by driving upward along the edge of the cover with a **dull cold chisel**.

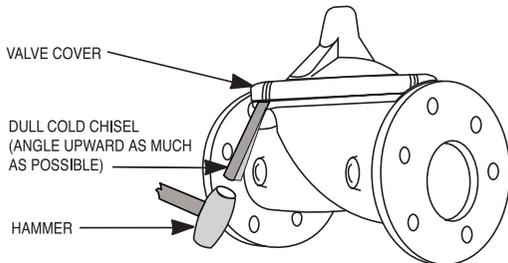

On 6" and smaller valves block and tackle or a power hoist can be used to lift valve cover by inserting proper size eye bolt in place of the center cover plug. on 8" and larger valves there are 4 holes (5/8" – 11 size) where jacking screws and/or eye bolts may be inserted for lifting purposes. **Pull cover straight up** to keep from damaging the integral seat bearing and stem.

COVER CENTER PLUG SIZE

Valve Size	Thread Size (NPT)
1 1/4" – 1 1/2"	1/4"
2" – 3"	1/2"
4" – 6"	3/4"
8" – 10"	1"
12"	1 1/4"
14"	1 1/2"
16"	2"
24"	2"
36"	2"

4. Remove the diaphragm and disc assembly from the valve body. With smaller valves this can be accomplished by hand by **pulling straight up on the stem so as not to damage the seat bearing**. On large valves, an eye bolt of proper size can be installed in the stem and the diaphragm assembly can be then lifted with a block and tackle or power hoist. Take care not to damage the stem or bearings. The valve won't work if these are damaged.

VALVE STEM THREAD SIZE

Valve Size	Thread Size (UNF Internal)
1 1/4" – 2 1/2"	10 – 32
3" – 4"	1/4 – 28
6" – 14"	3/8 – 24
16"	1/2 – 20
24"	3/4 – 16
36"	3/4 – 16

5. The next item to remove is the stem nut. Examine the stem threads above the nut for signs of mineral deposits or corrosion. If the threads are not clean, use a wire brush to remove as much of the residue as possible. Attach a good fitting wrench to the nut and give it a sharp "rap" rather than a steady pull. Usually several blows are sufficient to loosen the nut for further removal. On the smaller valves, the entire diaphragm assembly can be held by the stem in a vise **equipped with soft brass jaws** before removing the stem nut.


The use of a pipe wrench or a vise without soft brass jaws scars the fine finish on the stem. No amount of careful dressing can restore the stem to its original condition. Damage to the finish of the stem can cause the stem to bind in the bearings and the valve will not open or close.

6. After the stem nut has been removed, the diaphragm assembly breaks down into its component parts. Removal of the disc from the disc retainer can be a problem if the valve has been in service for a long time. Using two screwdrivers inserted along the outside edge of the disc usually will accomplish its removal. Care should be taken to preserve the spacer washers in water, particularly if no new ones are available for re-assembly.

7. The only part left in the valve body is the seat which ordinarily does not require removal. Careful cleaning and polishing of inside and outside surfaces with 400 wet/dry sandpaper will usually restore the seat's sharp edge. If, however, it is badly worn and replacement is necessary, it can be easily removed.

Seats in valve sizes 1 1/4" through 6" are threaded into the valve body. They can be removed with accessory X109 Seat Removing Tool available from the factory. On 8" and larger valves, the seat is held in place by flat head machine screws. Use a tight-fitting, long shank screwdriver to prevent damage to seat screws. If upon removal of the screws the seat cannot be lifted out, it will be necessary to use a piece of angle or channel iron with a hole drilled in the center. Place it across the body so a long stud can be inserted through the center hole in the seat and the hole in the angle iron. By tightening the nut a uniform upward force is exerted on the seat for removal.

NOTE: Do not lift up on the end of the angle iron as this may force the integral bearing out of alignment, causing the stem to bind.

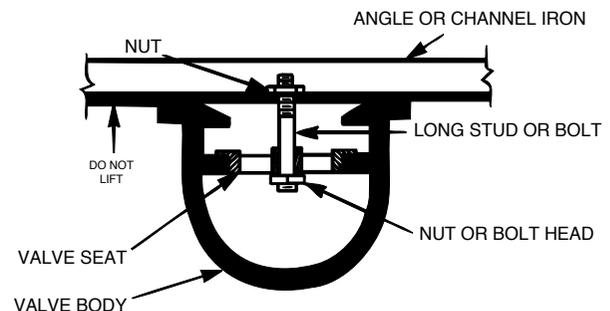

Lime Deposits

One of the easiest ways to remove lime deposits from the valve stem or other metal parts is to dip them in a 5-percent muriatic acid solution just long enough for the deposit to dissolve. This will remove most of the common types of deposits. **CAUTION: USE EXTREME CARE WHEN HANDLING ACID.** Rinse parts in water before handling. If the deposit is not removed by acid, then a fine grit (400) wet or dry sandpaper can be used with water.

Inspection of Parts

After the valve has been disassembled, each part should be examined carefully for signs of wear, corrosion, or any other abnormal condition. Usually, it is a good idea to replace the rubber parts (diaphragm and disc) unless they are free of signs of wear. These are available in a repair kit. Any other parts which appear doubtful should be replaced. **WHEN ORDERING PARTS, BE SURE TO GIVE COMPLETE NAMEPLATE DATA, ITEM NUMBER AND DESCRIPTION.**

NOTE: If a new disc isn't available, the existing disc can be turned over, exposing the unused surface for contact with the seat. The disc should be replaced as soon as practical.

Reassembly

1. Reassembly is the reverse of the disassembly procedure. If a new disc has been installed, it may require a different number of spacer washers to obtain the right amount of "grip" on the disc. When the diaphragm assembly has been tightened to a point where the diaphragm cannot be twisted, the disc should be compressed very slightly by the disc guide. Excessive compression should be avoided. Use just enough spacer washers to hold the disc firmly without noticeable compression.

2. **MAKE SURE THE STEM NUT IS VERY TIGHT.** Attach a good fitting wrench to the nut and give it a sharp "rap" rather than a steady pull. Usually several blows are sufficient to tighten the stem nut for final tightening. Failure to do so could allow the diaphragm to pull loose and tear when subjected to pressure.

3. Carefully install the diaphragm assembly by lowering the stem through the seat bearing. Take care not to damage the stem or bearing. Line up the diaphragm holes with the stud or bolt holes on the body. On larger valves with studs, it may be necessary to hold the diaphragm assembly up part way while putting the diaphragm over the studs.

4. Put spring in place and replace cover. Make sure diaphragm is lying smooth under the cover.

5. Tighten cover nuts firmly using a cross-over pattern until all nuts are tight.

6. Test Hytrol Valve before re-installing pilot valve system.

Test Procedure After Valve Assembly

There are a few simple tests which can be made in the field to make sure the Hytrol Valve has been assembled properly. Do these before installing pilot system and returning valve to service. These are similar to the three troubleshooting tests.

1. Check the diaphragm assembly for freedom of movement after all pressure is removed from the valve. **SEE CAUTION.** Insert fabricated tool into threaded hole in top of valve stem, and lift the diaphragm assembly manually. Note any roughness, sticking or grabbing. The diaphragm assembly should move smoothly throughout entire valve stroke. The tool is fabricated from rod that is threaded on one end to fit valve stem (See chart in Step 4 of "Disassembly" section.) and has a "T" Bar handle of some kind on the other end for easy gripping.

Place marks on this diaphragm assembly lifting tool when the valve is closed and when manually positioned open. The distance between the two marks should be approximately the stem travel shown in stem travel chart. (See "Freedom of Movement Check" section.) If the stroke is different than that shown, there is a good reason to believe something is mechanically restricting the stroke of the valve. The cover must be removed, the obstruction located and removed. (See "Maintenance" Section for procedure.)



Due to the weight of the diaphragm assembly this procedure is not possible on valves 8" and larger. On these valves, the same determination can be made by carefully introducing a low pressure-less than five psi) into the valve body with the cover vented. **SEE CAUTION.** Looking in cover center hole see the diaphragm assembly lift easily without hesitation, and then settle back easily when the pressure is removed.

2. To check the valve for drip-tight closure, a line should be connected from the inlet to the cover, and pressure applied at the inlet of the valve. If properly assembled, the valve should hold tight with as low as ten PSI at the inlet. See "Tight Sealing Check" section.)

3. With the line connected from the inlet to the cover, apply full working pressure to the inlet. Check all around the cover for any leaks. Re-tighten cover nuts if necessary to stop leaks past the diaphragm.



4. Remove pressure, then re-install the pilot system and tubing exactly as it was prior to removal. **Bleed air from all high points.**

5. Follow steps under "Start-Up and Adjustment" Section in Technical Manual for returning complete valve back to service.

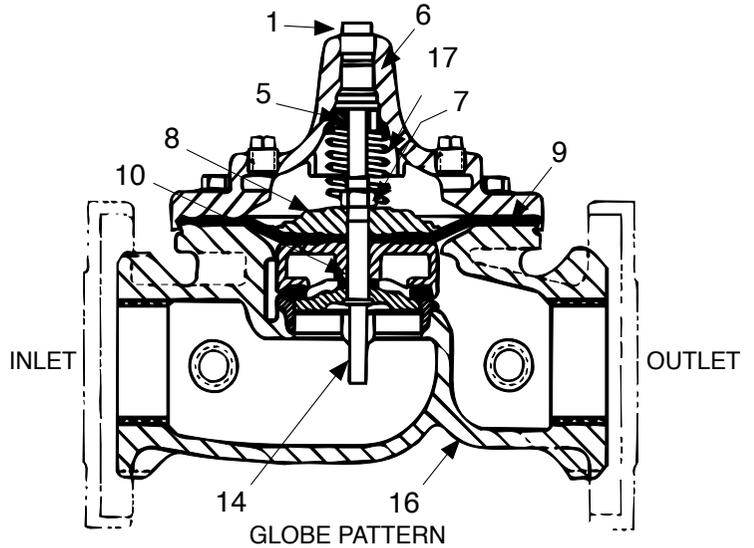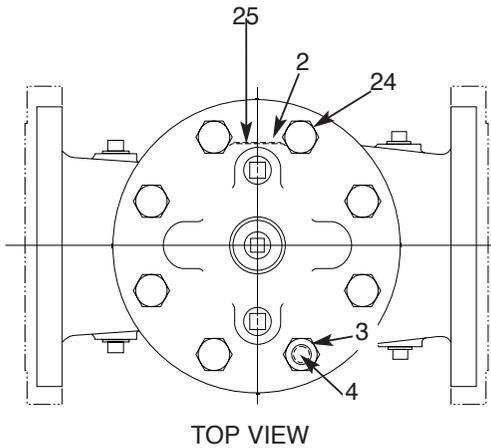


PARTS LIST


Item	Description
1.	Pipe Plug
2.	Drive Screws (for nameplate)
3.	Hex Nut (8" and larger)
4.	Stud (8" and larger)
5.	Cover Bearing
6.	Cover
7.	Stem Nut
8.	Diaphragm Washer
9.	Diaphragm
10.	Spacer Washers
11.	Disc Guide
12.	Disc Retainer
13.	Disc
14.	Stem
15.	Seat
16.	Body
17.	Spring
22.	Flat Head Screws (8" and larger)
23.	Seat O-Ring
24.	Hex head Bolt (1 1/4" thru 4")
25.	Nameplate
26.	Upper Spring Washer (Epoxy coated valves only)
27.	Lower Spring Washer (Epoxy coated valves only)
28.	Cover Bearing Housing (16" only)
29.	Cover O-Ring (16" only)
30.	Hex Bolt (16" only)
31.	Pipe Cap (16" only)

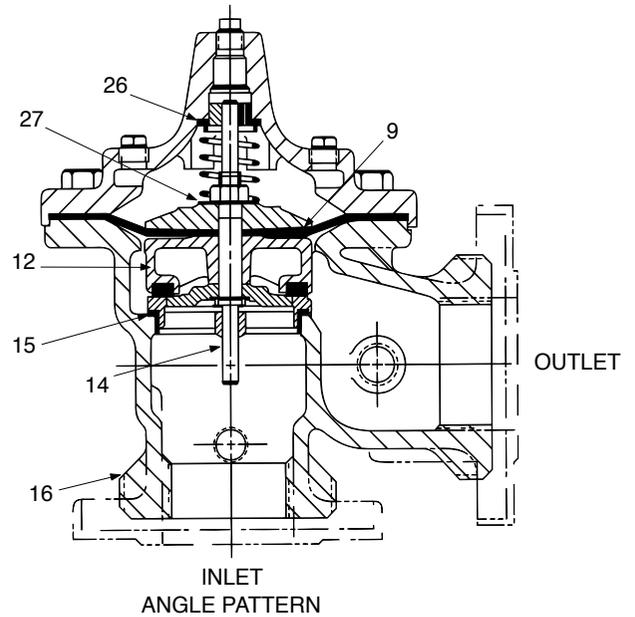

1 1/4" - 6" SEAT DETAIL

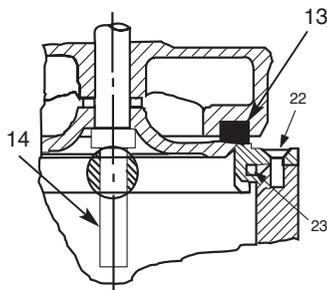

8" - 24" SEAT DETAIL

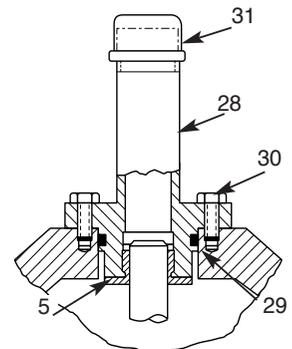

16" COVER DETAIL

INSTALLATION / OPERATION / MAINTENANCE




— MODEL — 100-01 Hytrol Valve Service Data

Description 100-01 Hytrol Valve

The Cla-Val Model 100-01 Hytrol Valve is a main valve for Cla-Val Automatic Control Valves. It is a hydraulically operated, diaphragm-actuated, globe or angle pattern valve.

This valve consists of three major components; body, diaphragm assembly, and cover. The diaphragm assembly is the only moving part. The diaphragm assembly uses a diaphragm of nylon fabric bonded with synthetic rubber. A synthetic rubber disc, contained on three and one half sides by a disc retainer and disc guide, forms a seal with the valve seat when pressure is applied above the diaphragm. The diaphragm assembly forms a sealed chamber in the upper portion of the valve, separating operating pressure from line pressure.

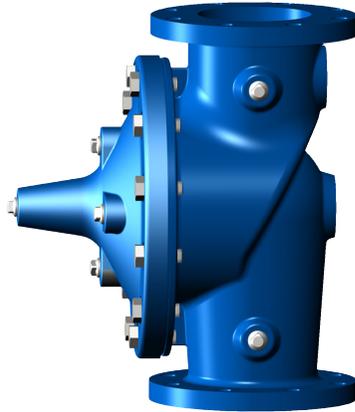

Description 100-20 600 Series Hytrol Valve

The Cla-Val Model 100-20 Hytrol Valve (600 Series main valve) have only one part -the body- that is different from standard 100 Series Cla-Val main valve parts. The remaining parts of the 600 series main valve are standard Cla-Val main valve parts. All service and maintenance information for the standard 100 Series main valves also apply to the 600 series main valves.

The most important thing to remember when ordering main valve repair kits and replacement parts, except for the body, all other parts are going to be for a smaller size main valve. Cla-Val identifies main valve parts with the flange size of the standard 100 Series main valve. Refer to the "Main Valve Sizes" chart below.

HYTROL Service Data

HYTROL SIZE		Stem Travel		Cover Capacity		Valve Stem Thread	Center Plug NPT	Cover Nut or Bolt		Cover Lifting Holes UNC	Cover Plug		Cover Torque		Stem Nut Torque			
inches	mm	inches	mm	Gallons	Liters	UNF-Internal	Plug NPT	Thread (Bolt)	Socket	Qty	Thread	Socket	ft. Lbs.	in. Lbs.	Thread	Socket (Long)	Lubed	DRY
1"	25	0.3	8	0.020	0.07	10-32	1/4"	1/4" - 20 (B)	7/16"	8			4	48	3/8" - 24		4	6
1 1/4"	32	0.4	10	0.020	0.07	10-32	1/4"	5/16" - 18 (B)	1/2"	8			8	96	7/16" - 20		6	10
1 1/2"	40	0.4	10	0.020	0.07	10-32	1/4"	5/16" - 18 (B)	1/2"	8			8	96	7/16" - 20		6	10
2"	50	0.6	15	0.032	0.12	10-32	1/2"	3/8" - 16 (B)	9/16"	8	3/8"	7/16"	12		1/2" - 20	3/4"	10	15
2 1/2"	65	0.7	18	0.043	0.16	10-32	1/2"	7/16" - 14 (B)	5/8"	8	1/2"	9/16"	20		5/8" - 18	15/16"	21	30
3"	80	0.8	20	0.080	0.30	1/4 - 28	3/4"	1/2" - 13 (B)	3/4"	8	1/2"	9/16"	30		5/8" - 18	15/16"	21	30
4"	100	1.1	23	0.169	0.64	3/8 - 24	1"	3/4" - 10 (B)	1 1/8"	12	3/4"	5/8"	110		3/4" - 16	1 1/16"	40	60
6"	150	1.7	43	0.531	2.00	3/8 - 24	1 1/2"	3/4" - 10 (B)	1 1/8"	12	3/4"	5/8"	110		7/8" - 14	1 5/16"	85	125
8"	200	2.3	58	1.26	4.80	3/8 - 24	1"	7/8" - 9	1 7/16	16	1"	13/16"	110		1 1/8" - 12	1 13/16"	125	185
10"	250	2.8	71	2.51	9.50	3/8 - 24	1 1/4"	1-1/8" - 7	1 13/16	20	1"	13/16"	160		1 1/2" - 12	1 7/8"	250	375
12"	300	3.4	86	4.0	15.10	3/8 - 24	1 1/2"	1-1/8" - 7	1 13/16	20	1"	13/16"	390		1 1/2" - 12	2 1/2"	270	400
14"	350	3.9	99	6.5	24.60	3/8 - 24	2"	1-1/4" - 7	2"	20	1"	13/16"	545		1 1/2" - 12	2 1/2"	280	420
16"	400	4.5	114	9.5	36.20	1/2 - 20	2"	1-1/4" - 7	2"	20	1"	13/16"	545		2" - 16	3"	500	750
24"	600	6.5	165	29.0	108.80	3/4 - 16 *	3/4"	1-1/2" - 12	2 3/8"	24	1"	13/16"	800		3" - 12	Special	1350	N/R

Grade 5 Bolts
"Heavy" Grade Nuts








Tighten cover nuts in a "star" cross-over pattern

**Must Use ONLY
Cla-Val Supplied part

* Adapter p/n 2594101E
inside 1/4" - 28

100-01 Hytrol Main Valve Assembly

BOLT/NUT TORQUING PROCEDURES ON VALVE COVERS

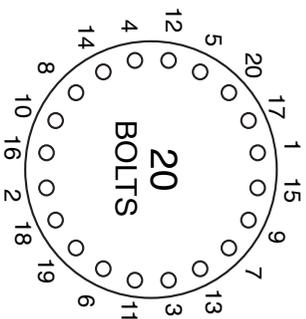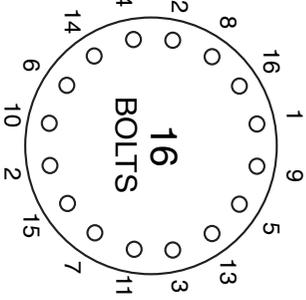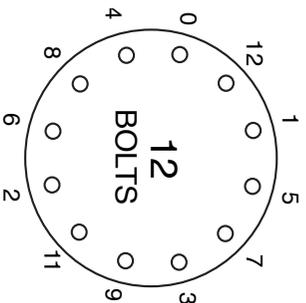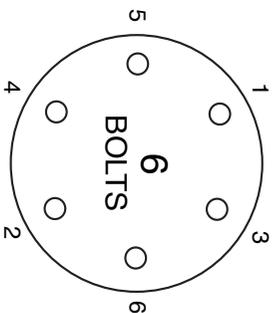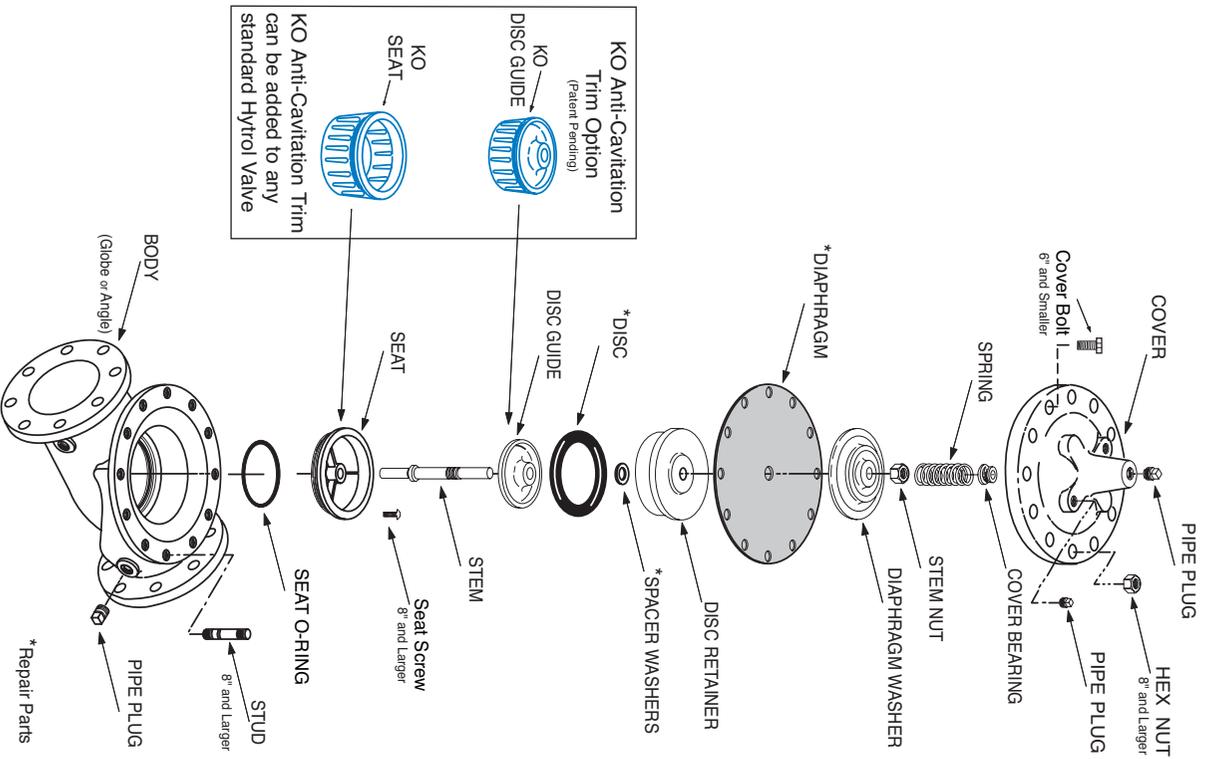

Follow this procedure when reassembling MAIN Valve:

1. Tightens bolts/nuts in a "Star" or "Cross-Over" Pattern following the numbers shown above to insure that cover seats evenly on the diaphragm material and body.
2. Torque the bolt/nuts in three stages:
 - A. To approximately 10% of final torque valve.
 - B. To approximately 75% of final torque valve.
 - C. To final required torque valve.
3. Valves that are to be tested to 375 PSI or higher should be retorqued after 24 hours.



— MODEL — **100-20**
(Reduced Internal Port)

600 Series Hytrol Valve

SERVICE AND MAINTENANCE OF 600 SERIES VALVES

The 600 series main valves have only one part -the body- that is different from standard 100 Series Cla-Val main valve parts. The remaining parts of the 600 series main valve are standard Cla-Val main valve parts. All service and maintenance information for the standard 100 Series main valves in this manual also apply to the 600 series main valves.

The most important thing to remember when ordering main valve repair kits and replacement parts, except for the body, all other parts are going to be for a smaller size main valve. Cla-Val identifies main valve parts with the flange size of the standard 100 Series main valve. Refer to the "Main Valve Sizes Comparison" chart. For example, if you are servicing a 6" 100-20 Hytrol and needed a repair kit, you would order a repair kit for a 4" 100-01 Hytrol. This kit is also suitable for a 6" 100-20 Hytrol. Complete Technical Manuals include a repair kit data sheet N-RK that shows this relationship.

When you order repair parts, it is a good idea to include valve nameplate data (size, catalog number, and part number) and description of the parts desired. Do this to be sure parts will fit the valve you are working on and not be too big for it. Pilot controls and repair kits maintenance information remain the same for 100 or 600 Series valves.

UNDERSTANDING THE 600 SERIES VALVES

In 1987, Cla-Val introduced the Model 100-20 Hytrol as the basic main valve for the 600 Series of automatic control valves. To identify all new valves using the 100-20 Hytrol, an existing catalog number is modified. Making a 600 Series catalog number is simply done by using a "6" in front of the two digit catalog numbers or replacing the "2" with a "6" in three digit catalog numbers. Current schematics reflect both catalog numbers together separated by a slash (i.e. - 90-01/690-01, 58-02/658-02, 210-01/610-01, etc). Since these two valves 'share' the same catalog number and schematic, they provide the same function in a system. The only difference between the two valves is the relative capacity of the two main valve series.

The 100-01 Hytrol is the basic main valve for Cla-Val automatic control valves. This valve is the current version of the Clayton Hytrol valve design originated in 1936. The 100-01 Hytrol is designed as a full flow area valve. This means that the inlet, seat and outlet openings are the same size. Thus, the pressure drop is kept to a minimum for this globe style design.

The 100-20 Hytrol valve has all of the basic features and advantages of the original 100-01 Hytrol. Only one part has been changed - the body. It is designed with different size inlet, seat and outlet openings. The 100-20 Hytrol has inlet and outlet flanges one valve size larger than the seat opening size. This results in what is sometimes called a "reduced port" main valve. For example, a 4" 100-20 valve has a 3" seat. Note: valve size is always determined by the flange size. The following chart compares the 100-01 and the 100-20 main valves.

Basic Main Valve Sizes Comparison


Globe Pattern Valves		
Flange Size (inch)	Seat Size	
	100-01 (100 Series)	100-20 (600 Series)
3	3	2
4	4	3
6	6	4
8	8	6
10	10	8
12	12	10
14	14	
16	16	12
20		16
24	24	16
Angle Pattern Valves		
Flange Size (inch)	Seat Size	
	100-01 (100 Series)	100-20 (600 Series)
4	4	3
6	6	4
8	8	6

The 100-20 Hytrol is available only in ductile iron, 150 and 300 pressure class, and Bronze trim standard. Available extra cost main valve options include stainless steel trim, epoxy coating, Dura-Kleen stem, Delrin sleeved stem, and high temperature rubber parts. All four basic main valves have a 600 Series version available with all of the same benefits and size relationships. The following chart shows the relationship of Cla-Val main valve catalog numbers.


Cla-Val Main Valves

Catalog Name	Catalog Number		
	Circa 1936	100-Series	600 Series
Hytrol	100 (Angle =2100)	100-01	100-20
Powertrol	100P & 100PA	100-02	100-21
Powercheck	100PC & 100PCA	100-03	100-22
Hycheck	181	100-04	100-23

100-20

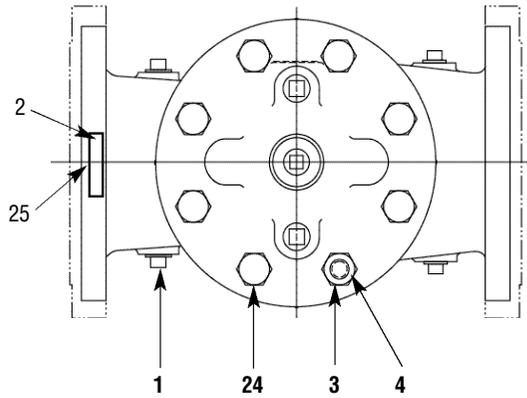

TOP VIEW

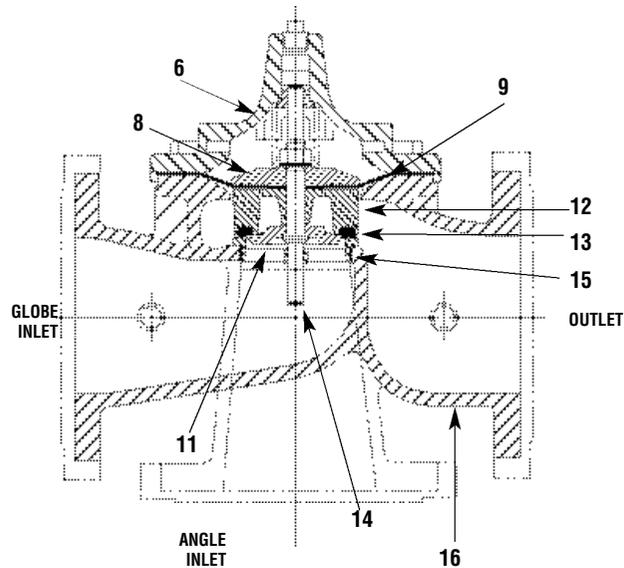


PARTS LIST


NO. DESCRIPTION

- 1 Pipe Plug
- 2 Drive Screws (for nameplate)
- 3 Hex Nut (8" and larger)
- 4 Stud (8" and larger)
- 5 Cover Bearing
- 6 Cover
- 7 Stem Nut
- 8 Diaphragm Washer
- 9 Diaphragm
- 10 Spacer Washers
- 11 Disc Guide
- 12 Disc Retainer
- 13 Disc
- 14 Stem
- 15 Seat
- 16 Body
- 17 Spring
- 22 Flat Head Screws (10" and larger)
- 23 Seat O-Ring
- 24 Hex Bolt (3 " Thru 6")
- 25 Nameplate (Mounted on inlet flange)
- 26 Upper Spring Washer (Epoxy coated valves only)
- 27 Lower Spring Washer (Epoxy coated valves only)
- 28 Cover Bearing Housing (20" & 24")
- 29 Cover Bearing Housing O-Ring (20" & 24")
- 30 Hex Bolt (20" & 24")
- 31 Pipe Cap (20" & 24")


WHEN ORDERING PARTS, BE SURE TO GIVE COMPLETE NAMEPLATE DATA, ITEM NUMBER AND DESCRIPTION.

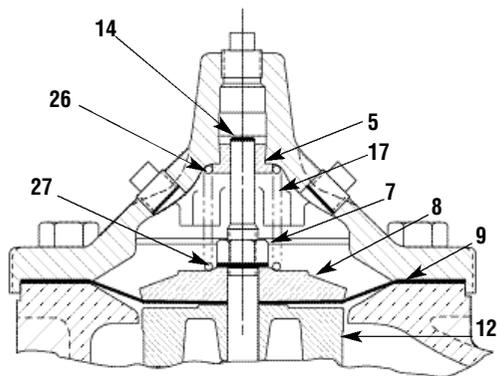

3" - 6" COVER DETAIL

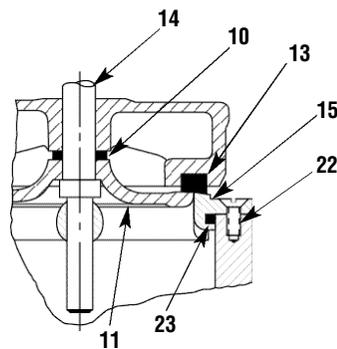

10" - 24" SEAT DETAIL

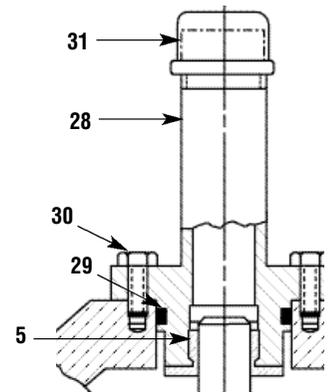

20" - 24" COVER DETAIL



— MODEL — **X101**

Valve Position Indicator & Pilot System Components




- **Positive Visual Indicator**
- **Frictionless**
- **Leak Proof**
- **Easy Maintenance and Cleaning**
- **Protected Indicator Rod**

The Cla-Val Model X101 Visual Position Indicator is designed to display Cla-Val valve position quickly and easily. A solid brass indicator rod fastened directly to the valve stem moves up and down inside a pyrex tube. The tube is contained within a brass housing which is open on two opposite sides to permit clear vision of the indicator rod.

To purge air that may be trapped in the valve cover, a vent valve in the top of the housing is provided. Model X101 valve position indicator is furnished complete for installation on specified size Cla-Val Automatic Control Valve.

Dimensions

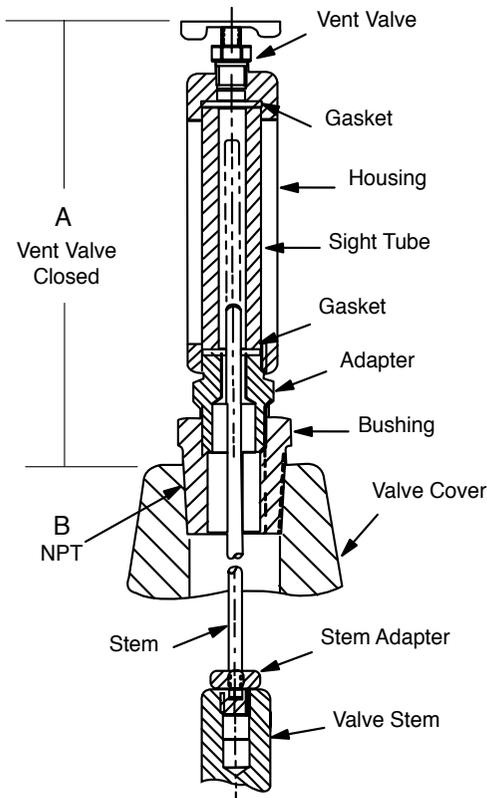

Dimension "A" is height added to valve by indicator assembly

VALVE SIZE	A INCHES	B NPT
1"	5.88	1/4"
1 1/4"	3.21	1/4"
1 1/2"	3.21	1/4"
2"	3.33	1/2"
2 1/2"	3.33	1/2"
3"	3.33	1/2"
4"	4.52	3/4"
6"	4.52	3/4"
8"	5.83	1"
10"	7.70	1"
12"	8.20	1 1/4"
14"	8.20	1 1/2"
16"	10.81	2"
24"	12.04	1"

Specifications

- Sizes: 1" thru 24"
 Materials: Brass, Pyrex Tube
 Pressure Rating: 400 psi
 Optional Material: Stainless Steel

Installation

Can be installed on any Cla-Val basic main valve in a few minutes. Simply replace the fitting on top of the valve cover with the indicator assembly.

When Ordering, Please Specify

1. Valve Size
2. Catalog No. X101
3. Valve Series No. (Appears on Valve Nameplate)
4. Optional Material
Stainless Steel



CSM-11 Solenoid Control

Body Material

Standard: Bronze with Monel Trim

Option: Bronze with Stainless Steel Trim



CDS6 Altitude Control

Wetted Body Material

Standard: Bronze with Stainless Steel Trim



No. of Springs	Altitude Ranges
1	5 - 40 ft
2	30 - 80 ft
3	70 - 120 ft
4	110 - 160 ft
5	150 - 200 ft

CDC-1 Check Valve



Size	Body Material	Trim Material
3/8"-1/2"	Brass	Delrin

CSC Swing Check Valve



Size	Body Material	Trim Material
3/8"-1"	Brass	Brass/Buna N

CN Series - Needle Valves



Size	Body Material	Trim Material
1/4"-1"	Standard: Bronze Option: Stainless Steel	Brass Stainless Steel

CK Series - Isolation Valve



Size	Body Material	Trim Material
3/8"-1"	Standard: Bronze Option: Stainless Steel	Stainless Steel/Teflon Stainless Steel/Teflon



CLA-VAL


Distributed By:
M&M Control Service, Inc.
Phone: 800-876-0036
Fax: 847-356-0747
Email: sales@mmcontrol.com

Represented By:



X-101

Valve Position Indicator

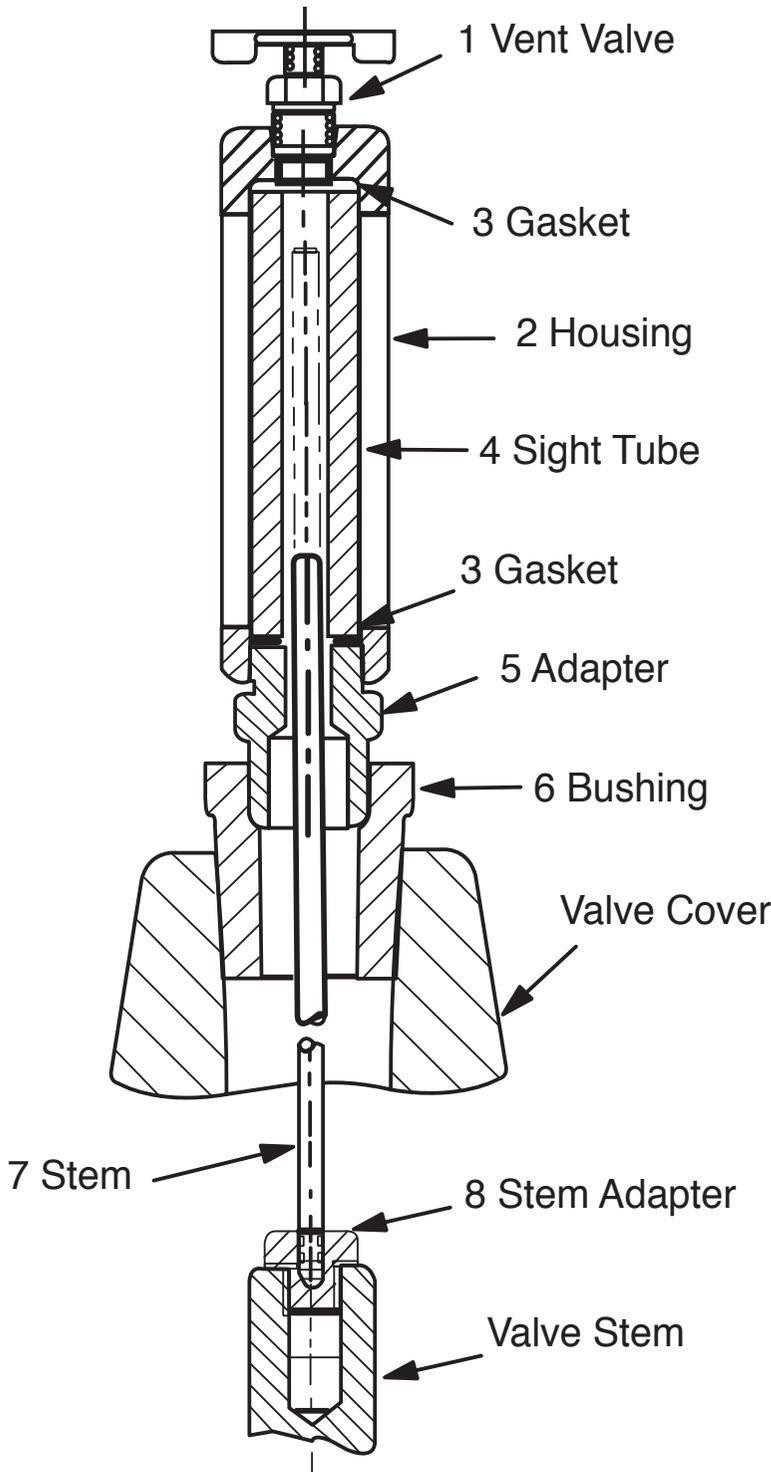

COMPLETE X101	
SIZE	STOCK NO.
1 1/4 - 1 1/2	C2812A
2	C8972G
2 1/2	C2607E
3	C2609A
4	9710001A
6	9710002J
8	C8581F
10	C9187A
12	31420D
14	30256C
16	30251D


ITEM	DESCRIPTION	MATERIAL
1	Vent Valve	Brass
2	Housing	Brass
3	*Gasket (2 Required)	Buna-N
4	*Sight Tube	Pyrex
5	Adapter	Brass
6	Busing	Brass
7	Stem	Brass
8	Stem Adapter	Brass

When ordering parts, please specify:

- All Nameplate data
- Item Number
- Description
- Material
- Part Number

CLA-VAL CO. NEWPORT BEACH, CALIFORNIA	CATALOG NO.	DRAWING NO. 67783	REV AW
TYPE OF VALVE AND MAIN FEATURES CK2 COCK/BALL VALVE		DESIGN	
		DRAWN MGR	4-02-80
		CHK'D KD	4-03-80
		APVD CH	4-07-80

SCALE: NONE

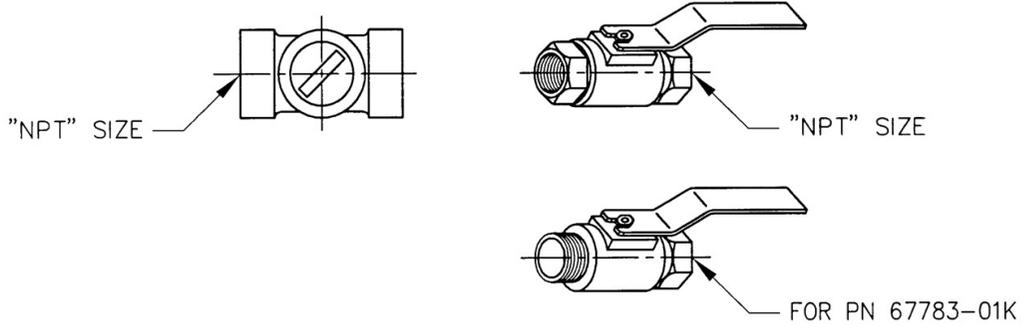

CLA-VAL PART NO. AND MATERIAL

BRONZE WITH HANDLE	STEEL WITH HANDLE	IRON WITH HANDLE	316 SST WITH HANDLE	316 SST W/ LOCKING HANDLE	BRONZE WITH HANDLE	MONEL WITH HANDLE	SIZE "NPT"
67783-01K*	-09C	-17F	-25J SUPSD BY-26G		-41F SUPSD BY-01K		1/8"
-02H	-10A	-18D	-26G	-51E SUPSD BY-26G -52C	-42D SUPSD BY-02H	-55F	1/4"
-03F *	-11J	-19B	-27E	-46E SUPSD BY-27E -53A	-45G -57B **	-48A SUPSD BY-49J	3/8"
-04D	-12G	-20K	-28C	-54J	-43B SUPSD BY-04D	-49J	1/2"
-05A	-13E	-21H	-29A		-44K SUPSD BY-05A	-56D	3/4"
-06J	-14C	-22F	-30J				1"
-07G	-15K	-23D	-31G				1 1/4"
-08E	-16H	-24B	-32E				1 1/2"
-50G			-47C				2"


* SEE ENGINEERING APPROVED VENDORS TABLE (SHEET 2 OF 2).
 ** HAMMOND VALVE 8501 ONLY.

04-07-03	AK	REMOVED COLUMN "MONEL W/ LOCKING HANDLE"; RELOCATED PN 67783-56D; ADDED VENDOR INFO FOR PN 67783-56D ON SHEET 2 (ECO 19327)	DATE	BY	DESCRIPTION	CAD REVISION RECORD - DO NOT REVISE MANUALLY
07-29-03	AK	ADDED PN 67783-57B ON SHEET 1 (ECO 19484)	01-31-03	AK	A-AT SEE REVISION FILE	LTR
						AU ADDED PN 67783-56D (ECO 19284)

THIS DRAWING IS THE PROPERTY OF CLA-VAL CO. AND SAME AND COPIES MADE THEREOF, IF ANY, SHALL BE RETURNED TO IT UPON DEMAND. DELIVERY AND DISCLOSURE HEREOF ARE SOLELY UPON CONDITION THAT THE SAME SHALL NOT BE USED, COPIED OR REPRODUCED, NOR SHALL THE SUBJECT HEREOF BE DISCLOSED IN ANY MANNER TO ANYONE FOR ANY PURPOSE, EXCEPT AS HEREIN AUTHORIZED, WITHOUT PRIOR WRITTEN APPROVAL OF CLA-VAL CO. THIS DRAWING IS SUBMITTED CONFIDENTIALLY AND MAY NOT BE USED IN THE MANUFACTURE OF ANY MATERIAL OR PRODUCT OTHER THAN SUCH MATERIALS AND PRODUCTS FURNISHED TO CLA-VAL CO. WHETHER OR NOT THE EQUIPMENT OR INFORMATION SHOWN HEREON IS PATENTED OR OTHERWISE PROTECTED, FULL TITLE AND COPYRIGHTS, IF ANY, IN AND TO THIS DRAWING AND/OR INFORMATION DELIVERED OR SUBMITTED ARE FULLY RESERVED CLA-VAL CO.



—MODEL— **100-01**
3/8"-1 Hytrol Valve

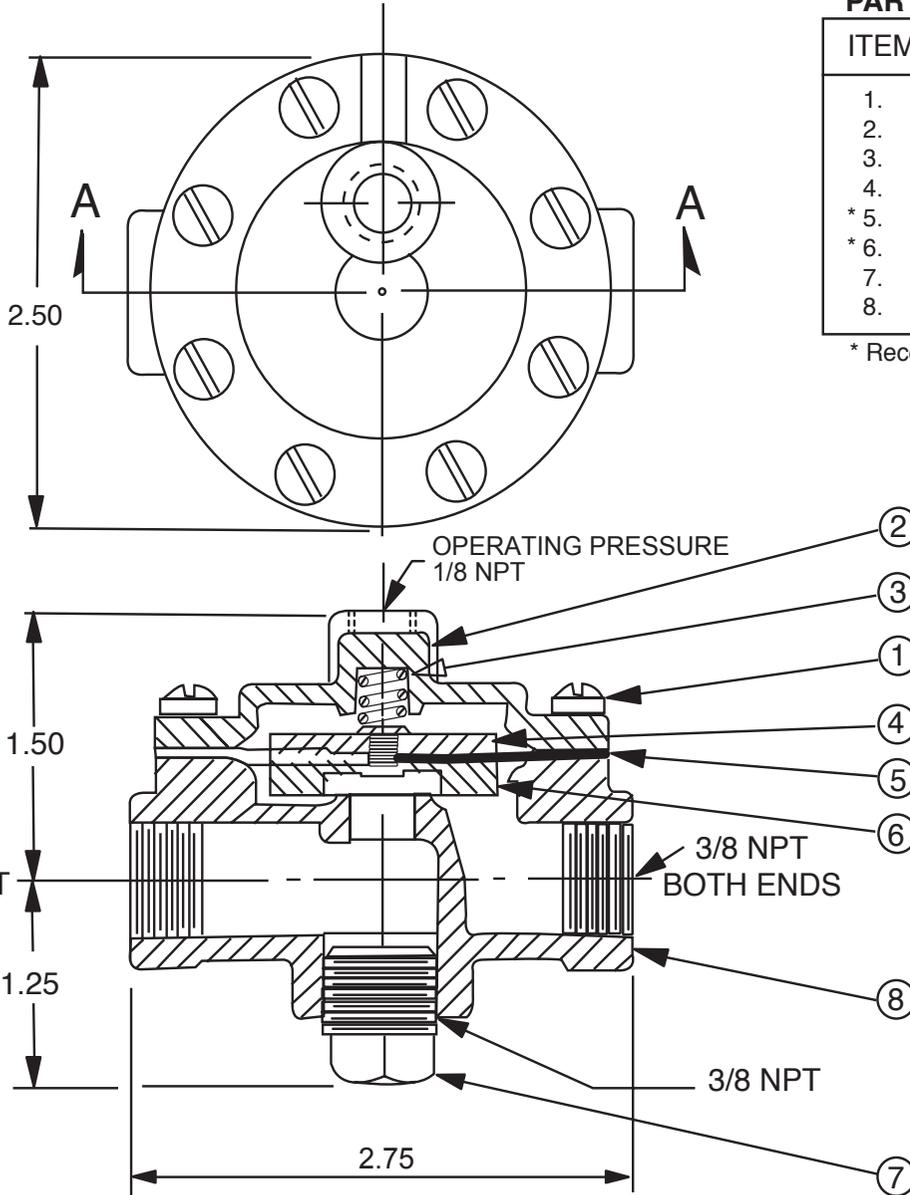

PARTS LIST

ITEM	DESCRIPTION
1.	Cover Screw (8 Required)
2.	Cover
3.	Spring
4.	Diaphragm Washer
* 5.	Diaphragm
* 6.	Disc Retainer Assembly
7.	Body Plug (3/8 NPT)
8.	Body

* Recommended Spare Parts

When Ordering parts, please specify

- All nameplate data
- Description
- Item Number
- Material

SECTION AA


100-01 3/8" HYTROL VALVE



—MODEL— **100-01**

1/2"-3/4"-1" Hytrol Valve

100-01 3/4" & 1/2" Hytrol Valve

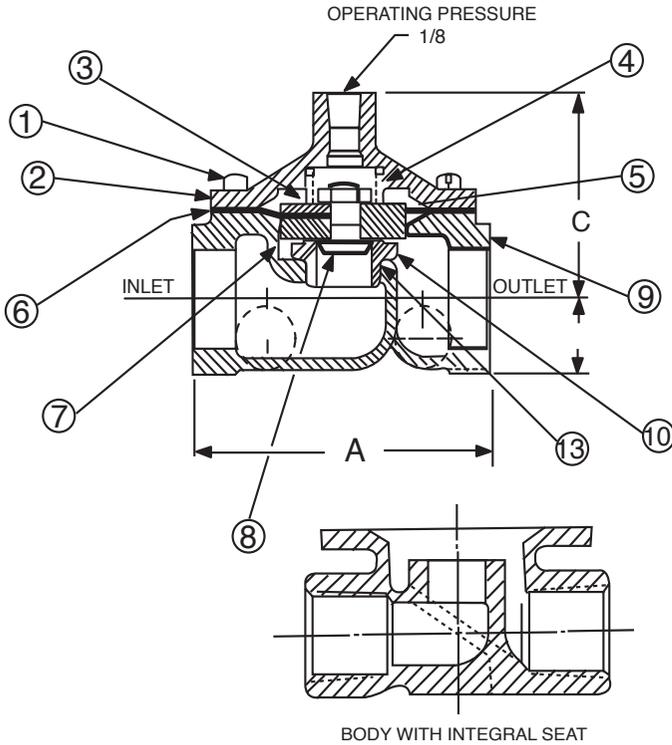

PARTS LIST

ITEM	DESCRIPTION
1	COVER SCREW
2	COVER
3	SPRING
4	STEM NUT
5	DIAPHRAGM WASHER
*6	DIAPHRAGM
*7	DISC RETAINER ASSEMBLY
8	DISC GUIDE & STEM
9	BODY
10	SEAT
11	NAMEPLATE
12	BODY PLUG HEX HD.
13	O-RING SEAT (FOR OLD STYLE BODY ONLY)


* Recommended Spare Parts

	1/2	3/4
A	1-7/16	3-1/2
C (MAXIMUM)	2-3/8	2-3/8
D	25/32	29/32

When Ordering parts, please specify

- All nameplate data
- Description
- Item Number
- Material

100-01 1" Hytrol Valve

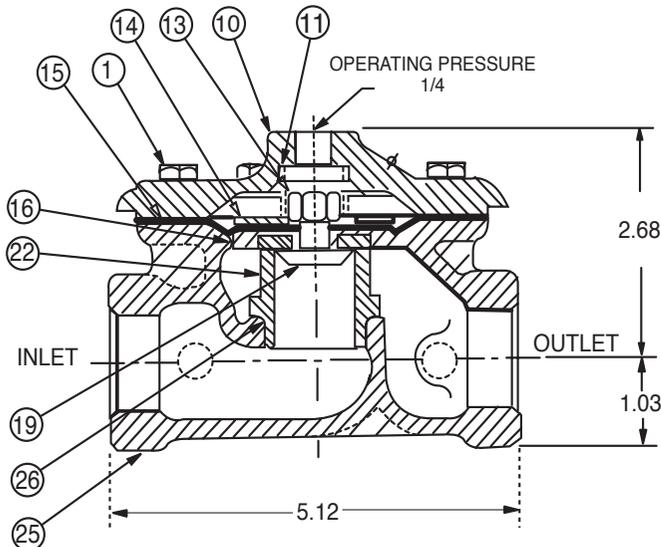

PARTS LIST

ITEM	DESCRIPTION
1	COVER SCREW
2	NAMEPLATE
3	NAMEPLATE SCREW
10	COVER
11	SPRING
13	STEM NUT
14	DIAPHRAGM WASHER
15	DIAPHRAGM
16	DISC RETAINER ASSEMBLY
19	DISC GUIDE
22	SEAT
24	BODY PLUG
25	BODY
26	O-RING, SEAT

* Recommended Spare Parts



— MODEL — **CRL**

Pressure Relief Control

DESCRIPTION

The CRL Pressure Relief Control is a direct acting, spring loaded, diaphragm type relief valve. It may be used as a self-contained valve or as a pilot control for a Cla-Val Main valve. It opens and closes within very close pressure limits.

INSTALLATION

The CRL Pressure Relief Control may be installed in any position. The control body (7) has one inlet and one outlet port with a side pipe plug (24) at each port. These plugs are used for control connections or gauge applications. The inlet in the power unit body (6) is the sensing line port. A flow arrow is marked on the body casting.

OPERATION

The CRL Pressure Relief Control is normally held closed by the force of the compression spring above the diaphragm; control pressure is applied under the diaphragm.

When the controlling pressure exceeds the spring setting, the disc is lifted off its seat, permitting flow through the control.

When controlling pressure drops below spring setting, the spring returns the control to its normally closed position.

ADJUSTMENT PROCEDURE

The CRL Pressure Relief Control can be adjusted to provide a relief setting at any point within the range found on the nameplate.

Pressure adjustment is made by turning the adjustment screw (9) to vary the spring pressure on the diaphragm. Turning the adjustment screw clockwise increases the pressure required to open the valve. Counterclockwise decreases the pressure required to open the valve.

When pressure adjustments are complete the jam nut (10) should be tightened and the protective cap (1) replaced. If there is a problem of tampering, lock wire holes have been provided in cap and cover. Wire the cap to cover and secure with lead seal.

DISASSEMBLY

The CRL Pressure Relief Control does not need to be removed from the line for disassembly. Make sure that pressure shut down is accompanied prior to disassembly. If the CRL is removed from the line for disassembly be sure to use a soft jawed vise to hold body during work.

Refer to Parts List Drawing for Item Numbers.

1. Remove cap (1), loosen jam nut (10) and turn adjusting screw counterclockwise until spring tension is relieved.
2. Remove the eight screws (4) holding the cover (3) and powerunit body (6). Hold the cover and powerunit together and place on a suitable work surface.
See NOTE under REASSEMBLY.
3. Remove the cover (3) from powerunit body (6). The spring (12) and two spring guides (11).
4. Remove nut (13) from stem (19) and slide off the belleville washer (14), the upper diaphragm washer (15) and the diaphragm (16).
5. Pull the stem (19) with the disc retainer assembly (21) through the bottom of powerunit. The lower diaphragm washer (17) will slide off of stem top.
6. Remove jam nut (23) and disc retainer assembly (21) from stem. Use soft jawed pliers or vise to hold stem. The polished surface of stem must not be scored or scratched.
7. The seat (22) need not be removed unless it is damaged. If removal is necessary use proper size socket wrench and turn counterclockwise.
Note: Some models have an integral seat in the body (7).

INSPECTION

Inspect all parts for damage, or evidence of cross threading. Check diaphragm and disc retainer assembly for tears, abrasions or other damage. Check all metal parts for damage, corrosion or excessive wear.

REPAIR AND REPLACEMENT

Minor nicks and scratches may be polished out using 400 grit wet or dry sandpaper fine emery or crocus cloth. Replace all O-rings and any damaged parts.

When ordering replacement parts, be sure to specify parts list item number and all nameplate data.

REASSEMBLY

In general, reassembly is the reverse of disassembly. However, the following steps should be observed:

1. Lubricate the O-Ring (18) with a small amount of a good grade of waterproof grease, (Dow Corning 44 medium grade or equal). Use grease sparingly and install O-ring in powerunit body (6).
2. Install stem (19) in powerunit body (6). Use a rotating motion with minimum pressure to let stem pass through O-ring.
Do Not Cut O-Ring.
3. Install O-ring (5) at top of stem (19). Place lower diaphragm washer (17) on the stem with the serrated side up. Position diaphragm (16), upper diaphragm washer (15), with serration down, and belleville washer (14) with concave side down.
4. Position powerunit body (6) as shown on parts list drawing (top view).
5. Continue reassembly as outlined in disassembly steps 1 through 3.





Note: Item (4) Screw will have a quantity of 8 for the 0-75 and 20-200psi design and a quantity of 4 for the 100-300psi design. Item (25) Screw is used on the 100-300psi design only. Install item (25), before item (4) for preload of item (12) spring.

SYMPTOM	PROBABLE CAUSE	REMEDY
Fails to open.	Controlling pressure too low.	Back off adjusting screw until valve opens.
Fails to open with spring compression removed.	Mechanical obstruction, corrosion, scale build-up on stem.	Disassemble, locate, and remove obstruction, scale.
Leakage from cover vent hole when controlling pressure is applied.	Diaphragm Damage	Disassembly replace damaged diaphragm.
	Loose diaphragm assembly.	Tighten upper diaphragm washer.
Fails to close.	No spring compression.	Re-set pressure adjustment.
Fails to close with spring compressed.	Mechanical obstruction.	Disassemble, locate and remove obstruction.



CRL

1/2" & 3/4" PRESSURE RELIEF CONTROL

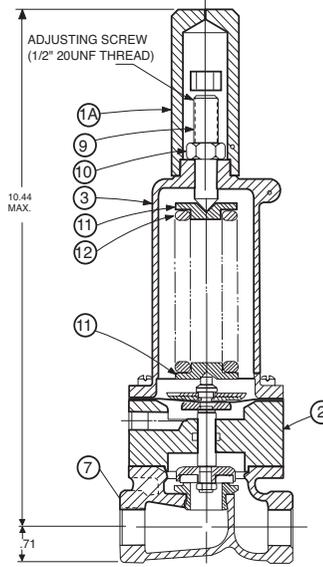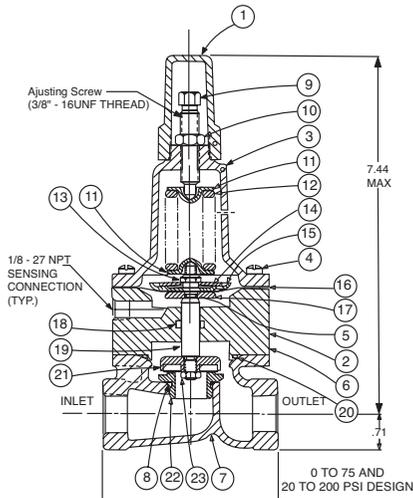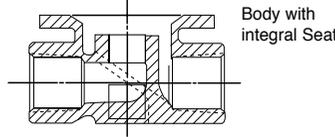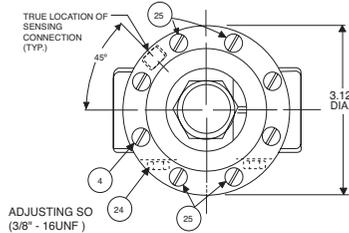

SIZE	SPRING RANGE	PART NUMBER
1/2"	0-75 PSI	79222-01E
1/2"	20-200 PSI	79222-02C
1/2"	100-300 PSI	82809-01D
3/4"	0-75 PSI	79229-01K
3/4"	20-200 PSI	79229-02H
3/4"	100-300 PSI	86005-01E

For 100-450 PSI Contact Factory

CRL RANGE PSI	APPROX. INCREASE FOR EACH CLOCKWISE TURN OF ADJUSTING SCREW
0 to 75	8.5 PSI
20 to 200	28.0 PSI
100 to 300	18.0 PSI

When ordering parts please specify:
 1. All Nameplate Data
 2. Item Part Number
 3. Item Description

Item	Description	Material	Part Number	Part Number	Part Number
			0-75	20-200	100-300
1	Cap	Plastic	67628J	67628J	1257601D
1A	Cap 100 to 300 psi Design	Plastic	1257601D	1257601D	1257601D
2	Nameplate	Brass	--	--	--
3	Cover	Bronze	C2544K	C2544K	44587E
4*	Screw Fil.Hd.10-32 x 1.88	303 SS	6757867E	6757867E	6757867E
5*	O-Ring	Rubber	00902H	00902H	00902H
6	Body, Powerunit	Bronze	7920504D	7920504D	7920504D
7	1/2" Body	Bronze	C7928K	C7928K	C7928K
	3/4" Body	Bronze	C9083B	C9083B	C9083B
8*	O-Ring, Seat	Rubber	00718H	00718H	00718H
9	Screw, Adjusting	Brass	7188201D	7188201D	7188201D
10	Nut Hex (Locking)	303 SS	6780106J	6780106J	6780106J
11	Guide, Spring	303 SS	71881H	71881H	1630301J
12	Spring,	CHR/VAN	71884B	71885J	1630201A
13	Nut, Stem, Upper	Bronze	73034B	73034B	73034B
14	Washer, Belleville	Steel	7055007E	7055007E	7055007E
15	Washer, Diaphragm (upper)	303 SS	71891G	71891G	71891G
16*	Diaphragm	Rubber	C1505B	C1505B	C1505B
17	Washer, Diaphragm (lower)	303 SS	45871B	45871B	45871B
18*	O-Ring, Stem	Rubber	00746J	00746J	00746J
19	Stem	303 SS	8982401F	8982401F	8982401F
20*	O-Ring, Body	Rubber	00767E	00767E	00767E
21*	Retainer Assembly, Disc	303 SS	C8964D	C8964D	C8964D
22	Seat	303 SS	62187A	62187A	62187A
23	Nut, hex, Stem, Lower	Bronze	6779806G	6779806G	6779806G
24	Pipe Plug	Bronze	6784701C	6784701C	6784701C
25*	Screw Fil.Hd, 10-32 x 2.25 (Qty 4 on 100-300 psi)	303 SS	6757867E	6757867E	6757867E
	FACTORY SET POINT		50 PSI	60 PSI	100 PSI
	REPAIR KIT*		9170007A	9170007A	9170007A



— MODEL — **CRA**
REMOTE SENSING TYPE

Pressure Reducing Control

DESCRIPTION

The CRA Pressure Reducing Control automatically reduces a higher inlet pressure to a lower outlet pressure. It is a direct acting, spring loaded, diaphragm type valve that operates hydraulically or pneumatically and is designed to sense pressure from a remote point. It may be used as a self-contained valve or as a pilot control for a Cla-Val Co. main valve. It will hold a constant downstream pressure at the remote sensing point within very close pressure limits.

OPERATION

The CRA Pressure Reducing Control is normally held open by the force of the compression spring above the diaphragm; delivery pressure acts on the underside of the diaphragm. Flow through the valve responds to changes in pressure at the the sensing point.

INSTALLATION

The CRA Pressure Reducing Control may be installed in any position. There is one inlet port and two outlets, for either straight or angle installation. The second outlet port can be used for a gauge connection. A flow arrow is marked on the body casting.

ADJUSTMENT PROCEDURE

The CRA Pressure Reducing Control can be adjusted to provide a delivery pressure range as specified on the nameplate.

Pressure adjustment is made by turning the adjustment screw to vary the spring pressure on the diaphragm. The greater the compression on the spring the higher the pressure setting.

1. Turn the adjustment screw in (clockwise) to increase delivery pressure.
2. Turn the adjustment screw out (counter-clockwise) to decrease the delivery pressure. When pressure adjustment is completed, tighten jam nut on adjustment screw and replace protective cap.

Flow rates are not critical during pressure setting. The approximate minimum flow rates given in the table are for the main valve on which the CRA is installed.

Valve Size	1 1/4"-3"	4"-8"	10"-16"
Minimum Flow GPM	15-30	50-200	300-650

MAINTENANCE

Disassembly

To disassemble follow the sequence of the item numbers assigned to parts in the sectional illustration.

Reassembly

Reassembly is the reverse of disassembly. Caution must be taken to avoid having the yoke (17) drag on the inlet nozzle of the body (18). Follow this procedure:

1. Place yoke (17) in body and screw the disc retainer assembly (16) until it bottoms.
2. Install gasket (14) and spring (19) for 2-30 psi range onto plug (13) and screw into body. Disc retainer must enter guide hole in plug as it is assembled. Screw the plug in by hand. Use wrench to tighten only.
3. Place gasket (25) and powertrol body (21) on yoke extension (17). Refer to sectional view for proper reassembly of (21) onto body (18).
4. Place lower diaphragm washer (24), "o" ring (22), diaphragm (12), upper diaphragm washer (11), and belleville washer (20) on yoke extension (17). Screw on diaphragm nut (10) finger tight.
5. Place two machine screws (4) through (21) (25) and screw into body (18). Do not include the diaphragm (12) in this operation. This holds parts aligned for next step, and allows the diaphragm to move and be properly located during tightening of nut (10).
6. Hold the diaphragm so that screw holes in the diaphragm (12)

and powertrol body (21) align. Tighten diaphragm nut (10) with a wrench. At the final tightening release the diaphragm and permit it to rotate approximately 5° to 10°. The diaphragm holes should now be properly aligned with the body holes.

To check for proper alignment proceed as follows:

Rotate diaphragm clockwise and counterclockwise as far as possible. Diaphragm screw holes should rotate equal distance on either side of powertrol body screw holes ±1/8".

Repeat assembly procedure until diaphragm and yoke are properly aligned. There must be no contact between yoke and body nozzle during its normal opening and closing movement. To simulate this movement hold powertrol body and diaphragm holes aligned. Move yoke to open and closed positions. There must be no evidence of contact or dragging.

7. Remove machine screws per step 5.
8. Install spring (9) with spring guide (8) on top of spring.
9. Install cover (5) using eight machine screws (4).
10. Replace adjusting screw (2) and nut (3), then cap (1).

SYMPTOM	PROBABLE CAUSE	REMEDY
Fails to open when pressure lowers	No spring compression	Tighten adjusting screw
	Mineral buildup on yoke extension (17)	Disassemble and clean part, Replace "O" rings (22) and (23).
	Damaged spring	Disassemble and replace.
	Spring guide (8) is not in place	Disassemble and place guide (8) on top of spring (9).
Fails to close when delivery pressure rises	Yoke dragging on inlet nozzle	Disassembled and reassemble use procedure.
	Spring compressed	Back off adjusting screw
	Mineral deposit on yoke extension (17)	Disassemble and clean part. Replace "o" rings (22) and (23).
	Mechanical obstruction	Disassemble and remove obstruction
	Worn disc	Disassemble, remove and replace disc retainer assembly. (16)
Leakage from cover vent hole	Yoke dragging on inlet nozzle	Refer to paragraph 6
	Damaged diaphragm (12)	Disassemble and replace
	Loose diaphragm nut (10)	Remove cover and tighten nut



CRA

REMOTE SENSING TYPE


Pressure Reducing Control

When ordering parts specify:

- All nameplate data
- Description
- Item number

SIZE (inch)	STOCK NUMBER	SEAT DIA	ADJ. RANGE (psi)
3/8	79744-03D	1/4	15-75
3/8	79744-04B	1/4	30-300
3/8	79744-06G	1/4	2-30
Factory set pressure:			PSI*per turn
15-75 set @ 20 psi			9.0
30-300 set @ 60 psi			27.0
2-30@ 10 psi			3.0

* Approximate - Final adjustment should be made with a pressure gauge and with flow.

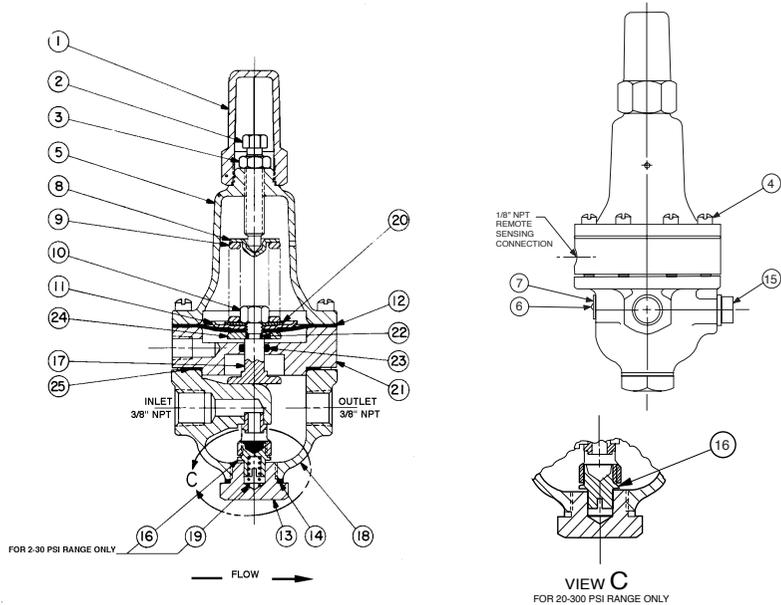

ITEM	DESCRIPTION	MATERIAL	PART NUMBER	LIST PRICE
1	Cap	PL	67628J	
2	Adjusting Screw	BRS	7188201D	
3	Jam Nut, 3/8—16	303	6780106J	
4*	Machine Screw 10-32 x 1-1/4"(Fil.Hd.) (8 required)	SS	6757874A	
5	Cover	BRS	C2544K	
6	Nameplate Screw	SS	67999D	
7	Nameplate	BRS	C002201G	
8	Spring Guide	302	71881H	
9	Spring			
	(15-75 psi)	CHR VAN	71884B	
	(30-300 psi)	CHR VAN	71885B	
	(2-30 psi)	SS	81594E	
10	Hex Nut 5/16 - 18	303	71883D	
11	Diaphragm Washer (upper)	302	71891G	
12*	Diaphragm	NBR	C6936D	
13	Plug, Body	BRS	V5653A	
14*	Gasket	FIB	40174F	
15	Plug, 3/8 NPT	BRS	6766003F	
16*	Disc Retainer Assy (15-75 psi & 30-300 psi)	BR/RUB	C5256H	
	Disc Retainer Assy (2-30 psi)	BR/RUB	C5255K	
17	Yoke	VBZ	C1799A	
18	Body & Seat Assy, Seat only 1/4"	BS	8339701J	
19*	Bucking Spring (Required with 2-30 psi)	302	VO5586	
20	Belleville Washer	STL	7055007E	
21	Powerrol Body	BRS	C3388A	
22*	O-Ring	NBR	00708J	
23*	O-Ring	NBR	00746J	
24	Diaphragm Washer (lower)	BRS	C1804J	
25	Gasket	NBC	8059401D	
	Repair Kit (no Bucking Spring) Item 19		9170003K	
	Repair Kit (with Bucking Spring) Item 19		9170001D	

* Suggested Repair Parts



Regulator Spring Color Coding Chart

Dwg#47117

*THESE FIGURES ARE ONLY APPROXIMATE. FINAL ADJUSTMENTS SHOULD BE MADE WITH A PRESSURE GAGE.

WIRE SIZE	SPRING NUMBER	COLOR	WIRE MATERIAL	CATALOG NUMBER	PSI RANGE	*PSI PER TURN
.080 DIA.	C0492D	BLUE	S.S.	CDB-7	0-7	.75
				CRL-5A	0-7	.75
.018 DIA.	82575C	--	S.S.	CRD	1.9-6.5	.61
				CRD-10A	1.9-6.5	.49
.116 DIA.	81594E	--	S.S.	CRD	2-30	3.0
				CRD-10A	2-30	2.4
.120 DIA.	V5654J	GREEN	CHR VAN	CRL-5A	5-25	4.0
				CRD	10-40	4.0
.162 DIA.	32447F	NATURAL	S.S.	CDB-7	10-60	12.0
				CRL-5A	10-60	12.0
				CRL-13	10-60	12.0
.162 DIA.	V5695B	YELLOW	MUSIC WIRE	CDB-7	20-80	14.5
				CRL-5A	20-80	14.5
				CRL-13	20-80	14.5
.207 DIA.	C1124B	CAD PLT	MUSIC WIRE	CDB-7	50-150	29.5
				CRL-13	50-150	29.5
				CRL-5A	50-150	29.5
.225 DIA.	V6515A	RED	MUSIC WIRE	CDB-7	65-180	44.0
				CRL-13	65-180	44.0
				CRL-5A	65-180	44.0
.115 X .218	71884B	RED	CHR VAN	CRL	0-75	8.5
				CRD	15-75	9.0
				CRD-10A	15-75	7.2
.118 X .225	71886J	GREEN	CHR VAN	CRL	20-200	28.0
				CRD	30-300	27.0
				CRD-10A	30-300	22.4
.225 X .295	1630201A	CAD PLT	CHR VAN	CRL	100-300	18.00
				CRL-5A	100-300	18.00
.440 X .219	48211H	CAD PLT	STEEL	CRA-18	200-450	17.0
				CRD-22	200-450	17.0
				CRL-4A	100-450	17.0
.187	20561901H	BLACK	STEEL	CRD	20-105	12.0
WIRE SIZE	SPRING NUMBER	COLOR	WIRE MATERIAL	CATALOG NUMBER	PSI RANGE	*FEET PER TURN
.080 DIA.	C0492D	BLUE	S.S.	CRA	4.5-15	.82
				CRD-2	4.5-15	.82
.375 DIA.	87719B 1 SPRING 2 SPRING 3 SPRING 4 SPRING 5 SPRING	EPOXY COATED	CHROME SILICON	CDS-5	5-40	1.0
					30-80	2.0
					70-120	3.0
					110-120	4.0
					150-200	5.0
.072 DIA.	V5097A	--	302SS	CVC	1-17	.7
.375 DIA.	2933502H 1 SPRING 2 SPRING 3 SPRING 4 SPRING 5 SPRING	EPOXY COATED	CHROME SILICON	CDS-6	5-40	.75
					30-80	1.50
					70-120	2.20
					110-120	3.00
					150-200	3.70


THE FOLLOWING CONTROL & SPRING P/N#S WERE REMOVED, 32656B, 31554K, 44591G, V65695B, & V5695B.
 ADDED CRL-13, CRL-5A, CRA, CRA-10A, CHANGED SPRING RANGES TO MATCH CURRENT CONTROLS.

*This drawing is the property of CLA-VAL and same and copies made thereof, if any, shall be returned to it upon demand. Delivery and disclosure hereof are made solely upon condition that the same shall not be used, copied or reproduced, nor shall the subject here of be disclosed in any manner to anyone for any purpose, except as herein authorized, without prior approval of CLA-VAL. Whether or not the equipment or information shown hereon is patented or otherwise protected, full title and copy-rights if any, in and to this drawing and/or information delivered or submitted are fully reserved by CLA-VAL.

DWG NO. 48833 SH 1 REV W

PARTS LIST

X58B ASSEMBLY STOCK NO.	ITEM NO. 1 ELBOW, TUBE FITTING		ITEM NO. 2 RESTRICTION PLUG				
	PART NO.	SIZE TUBE X NPT	MATERIAL	TYPE FITTING	PART NO.	MATERIAL	ORIFICE ϕ
43395D	43399F	1/4 X 3/8	BRASS	45° FLARE	43396B	S.STEEL	.063
65727A	43399F	1/4 X 3/8	BRASS	45° FLARE	37816G	S.STEEL	.031
43033A	43034J	1/4 X 1/4	BRASS	45° FLARE	43035F	DELIRIN	.063
82601G	82602E	1/4 X 1/8	BRASS	45° FLARE	82603C	DELIRIN	.031
40322A	40318J	3/8 X 1/8	BRASS	45° FLARE	C9447J	S.STEEL	.063
42344C	40318J	3/8 X 1/8	BRASS	45° FLARE	42345K	DELIRIN	.063
42344-002	40318-008	3/8 X 1/8	BRASS	45° FLARE	42345-009	DELIRIN	.063
-88542-	43399F-	1/4 X 3/8-	BRASS-	45° FLARE-	42345-	DELIRIN-	.063-
C9445C	C9450C	3/8 X 1/4	BRASS	45° FLARE	C9446A	S.STEEL	.031
42781F	C9450C	3/8 X 1/4	BRASS	45° FLARE	42345K	DELIRIN	.063
-70344-	70343K-	3/8 X 1/4-	S-STEEL-	37° FLARE-	83456E-	DELIRIN-	.040-
81065F	C9449E	3/8 X 3/8	BRASS	45° FLARE	43304F	DELIRIN	.188
C9442K	C9449E	3/8 X 3/8	BRASS	45° FLARE	C9446A	S.STEEL	.031
C9443H	C9449E	3/8 X 3/8	BRASS	45° FLARE	42345K	DELIRIN	.063
C9444F	C9449E	3/8 X 3/8	BRASS	45° FLARE	79912C	DELIRIN	.125
42360J	C9449E	3/8 X 3/8	BRASS	45° FLARE	42361G	S.STEEL	.035
-39739-	39740G-	3/8 X 3/8-	S-STEEL-	37° FLARE-	42345-	DELIRIN-	.063-
-44963-	39740G-	3/8 X 3/8-	S-STEEL-	37° FLARE-	79912C-	DELIRIN-	.125-
-44999B-	39740G-	3/8 X 3/8-	S-STEEL-	37° FLARE-	43304F-	DELIRIN-	.188-
70374E	C9449E	3/8 X 3/8	BRASS	45° FLARE	83456E	DELIRIN	.040
43033-01J	43034J	1/4 X 1/4	BRASS	45° FLARE	82603C	DELIRIN	.031

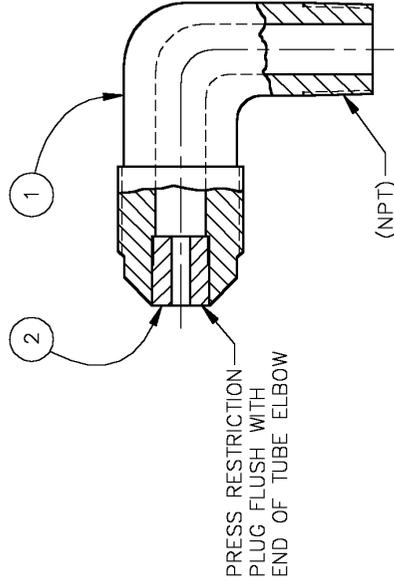

STAIN ASSEMBLY FOR IDENTIFICATION WITH 74234-03

CONTRACT NO. _____		GLA-VAL CO. NEWPORT BEACH, CALIFORNIA	
APPROVALS	DATE	TITLE	REV
DRAWN JD	10-25-77	X58B RESTRICTION ASSEMBLIES	
CHECKED MDJ	10-26-77		
APPROVED MF	10-26-77		
ENGR			
CAGE CODE	DWG NO.	SCALE	SHEET
B 86184	48833	NONE	1 OF 1

UNLESS OTHERWISE SPECIFIED TOLERANCES ARE: ANGULAR DECIMALS .03 ± .5° FRACTIONS .XX ± .001 ± .002 SURFACE FINISH 125 BREAK CORNERS .010 MAX --DO NOT SCALE DRAWING--

This drawing is the property of GLA-VAL CO. and some and copies made therefor, if any, shall be returned to it upon completion of the work. It is to be used only for the condition that the same shall not be used, copied or reproduced, nor shall the subject hereof be disclosed in any manner to anyone for any purpose, except as herein authorized, without the written consent of the manufacturer. The manufacturer confidentially and may not be used in the manufacture of any material or product other than such materials and products furnished to GLA-VAL CO. Whether or not the equipment or information shown hereon is patented or otherwise protected, full information is hereby given that if any information or information delivered or submitted are fully reserved by GLA-VAL CO.

CVCL 1 ② 3 4

DIST. CODE 007A

SHEET 1 OF 1



NEWPORT BEACH, CALIFORNIA

CATALOG NO.
CSC


DRAWING NO.
92667

REV.
A

TYPE OF VALVE AND MAIN FEATURES

CSC SWING CHECK VALVE

DESIGN		
DRAWN	CH	11-5-76
CHK'D	MF	11-8-76
APVD	JAZ	11-9-76

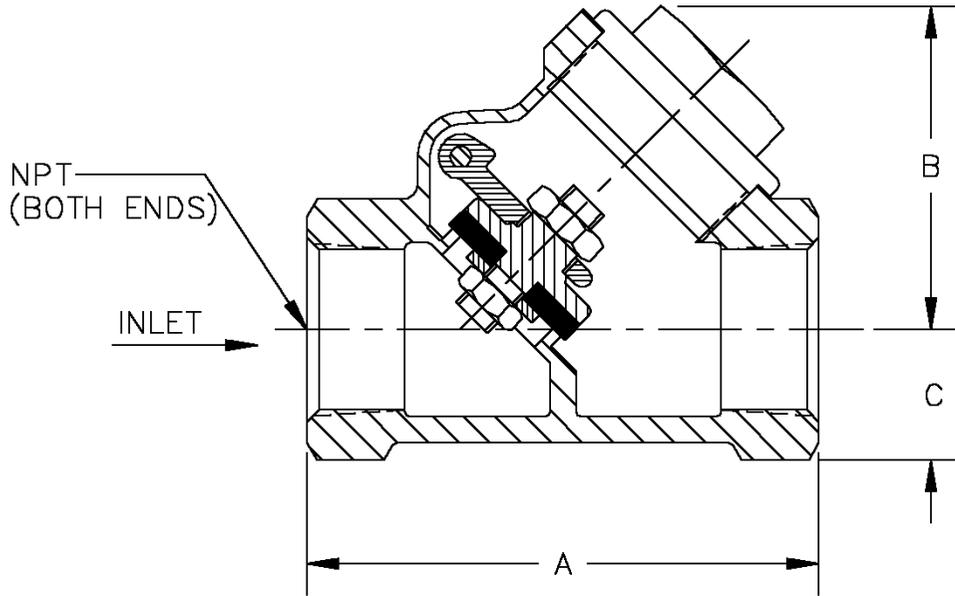



PIPE SIZE NPT	A	B	C
.25 (1/4)	2.13	1.63	.50
.38 (3/8)	2.13	1.63	.50
.50 (1/2)	2.44	1.69	.63
.75 (3/4)	2.94	1.88	.75
1.00 (1)	3.19	2.09	.94

CAD REVISION RECORD - DO NOT REVISE MANUALLY

LTR	DESCRIPTION	BY	DATE
A	REDRAWN ON CAD (ECO 14229)	EK	11-15-93

THIS DRAWING IS THE PROPERTY OF CLA-VAL CO. AND SAME AND COPIES MADE THEREOF, IF ANY, SHALL BE RETURNED TO IT UPON DEMAND. DELIVERY AND DISCLOSURE HEREOF ARE SOLELY UPON CONDITION THAT THE SAME SHALL NOT BE USED, COPIED OR REPRODUCED, NOR SHALL THE SUBJECT HEREOF BE DISCLOSED IN ANY MANNER TO ANYONE FOR ANY PURPOSE, EXCEPT AS HEREIN AUTHORIZED, WITHOUT PRIOR WRITTEN APPROVAL OF CLA-VAL CO. THIS DRAWING IS SUBMITTED CONFIDENTIALLY AND MAY NOT BE USED IN THE MANUFACTURE OF ANY MATERIAL OR PRODUCT OTHER THAN SUCH MATERIALS AND PRODUCTS FURNISHED TO CLA-VAL CO. WHETHER OR NOT THE EQUIPMENT OR INFORMATION SHOWN HEREON IS PATENTED OR OTHERWISE PROTECTED, FULL TITLE AND COPYRIGHTS, IF ANY, IN AND TO THIS DRAWING AND/OR INFORMATION DELIVERED OR SUBMITTED ARE FULLY RESERVED CLA-VAL CO.®

PARTS LIST		
ITEM NO	DESCRIPTION	QTY.
1	BODY	1
2	SCREEN	1
3	STEM	1
4	BONNET	1
5	PLUG, STRAINER	1
6	O-RING, PLUG	1
7	PLUG, PIPE 1/4 NPT	1
8	O-RING, BONNET	1
9	O-RING, STEM	1
10	NUT, HEX JAM	1
11	PLUG, PIPE 3/8NPT	1
12	PLUG, PIPE 1/8 NPT	2

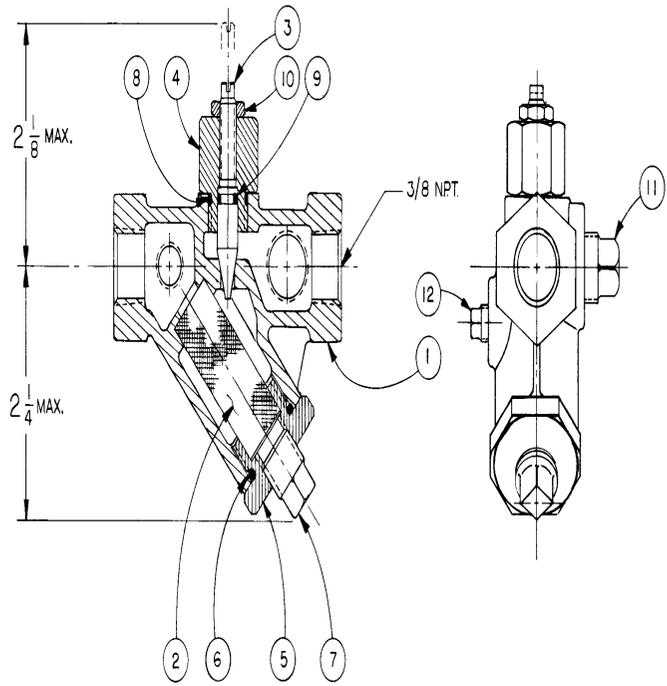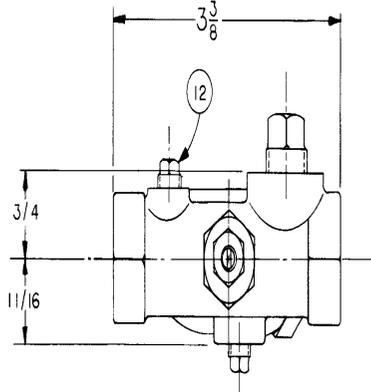

CLA-VAL CO. NEWPORT BEACH, CALIFORNIA, U.S.A.

DESCRIPTION 3/8" X42N-3 STRAINER & NEEDLE VALVE ASSEMBLY

CODE IDENT. NUMBER **86184**

LTR	DESCRIPTION	BY	DATE
REVISION RECORD			
DR	<i>Don Patton</i>		5-1-81
CHK	<i>Ch. Tuccillo</i>		5-5-81
APPD	<i>AT</i>		5-11-81
SCALE <i>FULL</i>			

DRAWING NUMBER	REV.
10250	

DWT CODE - 20 74



Cla-Val Product Identification


How to Order

Proper Identification


For ordering repair kits, replacement parts, or for inquiries concerning valve operation, it is important to properly identify Cla-Val products already in service by including all nameplate data with your inquiry. Pertinent product data includes valve function, size, material, pressure rating, end details, type of pilot controls used and control adjustment ranges.

Identification Plates

For product identification, cast-in body markings are supplemented by identification plates as illustrated on this page. The plates, depending on type and size of product, are mounted in the most practical position. **It is extremely important that these identification plates are not painted over, removed, or in any other way rendered illegible.**

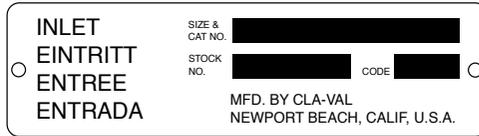


This brass plate appears on valves sized 2 1/2" and larger and is located on the top of the inlet flange.




These two brass plates appear on 3/8", 1/2", and 3/4" size valves and are located on the valve cover.




This brass plate appears on altitude valves only and is found on top of the outlet flange.




These two brass plates appear on threaded valves 1" through 3" size or flanged valves 1" through 2". It is located on only one side of the valve body.

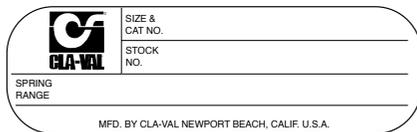


This tag is affixed to the cover of the pilot control valve. The adjustment range appears in the spring range section.



This brass plate is used to identify pilot control valves. The adjustment range is stamped into the plate.

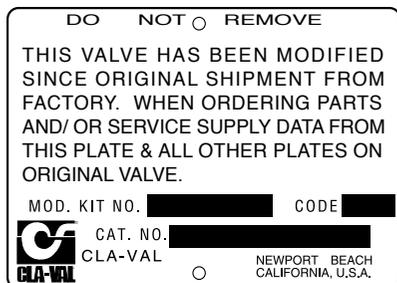

This aluminum plate is included in pilot system modification kits and is to be wired to the new pilot control system after installation.

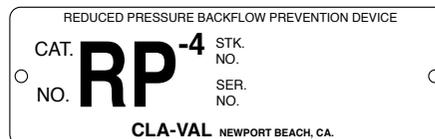

This brass plate is used on our backflow prevention assemblies. It is located on the side of the Number Two check (2" through 10"). The serial number of the assembly is also stamped on the top of the inlet flange of the Number One check.



HOW TO ORDER

Distributed By:
M&M Control Service, Inc.
Phone: 800-876-0036
Fax: 847-356-0747
Email: sales@mmcontrol.com

SPECIFY WHEN ORDERING

- Model Number
- Globe or Angle Pattern
- Adjustment Range
(As Applicable)
- Valve Size
- Threaded or Flanged
- Body and Trim Materials
- Optional Features
- Pressure Class

UNLESS OTHERWISE SPECIFIED

- Globe or angle pattern are the same price
 - Ductile iron body and bronze trim are standard
 - X46 Flow Clean Strainer or X43 "Y" Strainer are included
 - CK2 Isolation Valves are included in price on 4" and larger valve sizes (6" and larger on 600 Series)
-

NOTES:

NOTES:



CLA-VAL

Distributed By:
M&M Control Service, Inc.
Phone: 800-876-0036
Fax: 847-356-0747
Email: sales@mmcontrol.com

Represented By:



— MODEL — **REPAIR KITS**

Complete Replacement Diaphragm Assemblies for 100-01 and 100-20 Hytrol Main Valves
For: Hytrol Main Valves with Ductile Iron, Bronze Trim Materials—**125/150 Pressure Class Only.**
FACTORY ASSEMBLED

Includes: Stem, Disc Guide, Disc, Disc Retainer, Spacer Washers, Diaphragm, Diaphragm Washer and Stem Nut.

Valve Size	Diaphragm Assembly Stock Number		Valve Size	Diaphragm Assembly Stock Number	
	100-01	100-20		100-01	100-20
3/8" (Also 81-01)	49097K	N/A	6"	40456G	33273E
1/2" - 3/4" (Also 81-01)	C2518D	N/A	8"	45276D	40456G
1"	C2520K	N/A	10"	81752J	45276D
1 1/4"-1 1/2"	C2522 F	N/A	12"	85533J	81752J
2"	C2524B	N/A	14"	89067D	N/A
2 1/2"	C2523D	N/A	16"	89068B	85533J
3"	C2525J	C2524B	20"	N/A	89068B
4"	33273E	C2525J	24"	N/A	89068B

Repair Kits for 100-01/100-20 Hytrol Valves

For: Hytrol Main Valves—**125/150 Pressure Class Only.**

Includes: Diaphragm, Disc (or Disc Assembly) and spare Spacer Washers.

Buna-N® Standard Material				Viton (For KB Valves)				
Valve Size	Repair Kit Stock Number		Valve Size	Repair Kit Stock Number		Valve Size	Repair Kit Stock Number	
	100-01	100-20		100-01	100-20		100-01	100-20
3/8" (Also 81-01)	9169801K	N/A	3/8" (Also 81-01)	9169806J	N/A	3/8" (Also 81-01)	9169806J	N/A
1/2" - 3/4" (Also 81-01)	9169802H	N/A	1/2" - 3/4" (Also 81-01)	9169807G	N/A	1/2" - 3/4" (Also 81-01)	9169807G	N/A
1"	9169803F	N/A	1"	9169808E	N/A	1"	9169808E	N/A
1 1/4" - 1 1/2"	9169804D	N/A	1 1/4" - 1 1/2"	9169809C	N/A	1 1/4" - 1 1/2"	9169809C	N/A
2"	9169805A	N/A	2"	9169810A	N/A	2"	9169810A	N/A
2 1/2"	9169811J	N/A	2 1/2"	9169817F	N/A	2 1/2"	9169817F	N/A
3"	9169812G	9169805A	3"	9169818D	9169810A	3"	9169818D	9169810A
4"	9169813E	9169812G	4"	9169819B	9169818D	4"	9169819B	9169818D
6"	9169815K	9169813E	6"	9169820K	9169819B	6"	9169820K	9169819B
8"	9817901D	9169815K	8"	9169834A	9169820K	8"	9169834A	9169820K
10"	9817902B	9817901D						
12"	9817903K	9817902B						
14"	9817904H	N/A						
16"	9817905E	9817903K						
20"	N/A	9817905E						
24"	9817906C	9817905E						

When ordering, please give complete nameplate data of the valve and/or control being repaired.
MINIMUM ORDER CHARGE APPLIES.

