


**Piping / Recirculation Diagram
PowerStation™ & Tempering Recirculation Loop**

Continuous Aquastat / Recirculation* ■

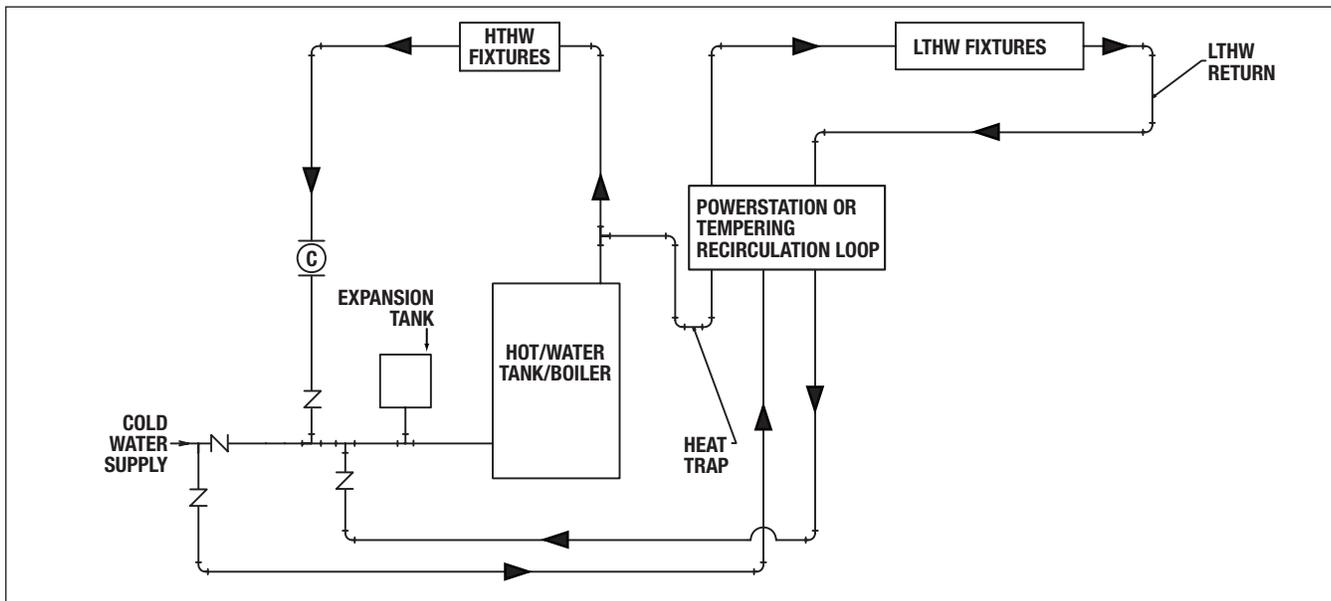

***USE AQUASTAT CONTROL ONLY WHEN REQUIRED MINIMUM FLOW IS GREATER THAN OR EQUAL TO THE VALVE MINIMUM FLOW (REFER TO LITERATURE).**

	TEMP/PRESSURE GAUGE
	FLOW DIRECTION
	CHECK VALVE
	BALL VALVE
	AUTOMATIC BALANCING VALVE
	CIRCULATOR

ENGINEERING APPROVAL

Project: _____

Contractor: _____

Architect/Engineer: _____